


# Sampling places of groundwater around the bank protection at the Fukushima Daiichi Nuclear Power Station

Eastern wave breaker

● Sampling places of groundwater around the bank protection

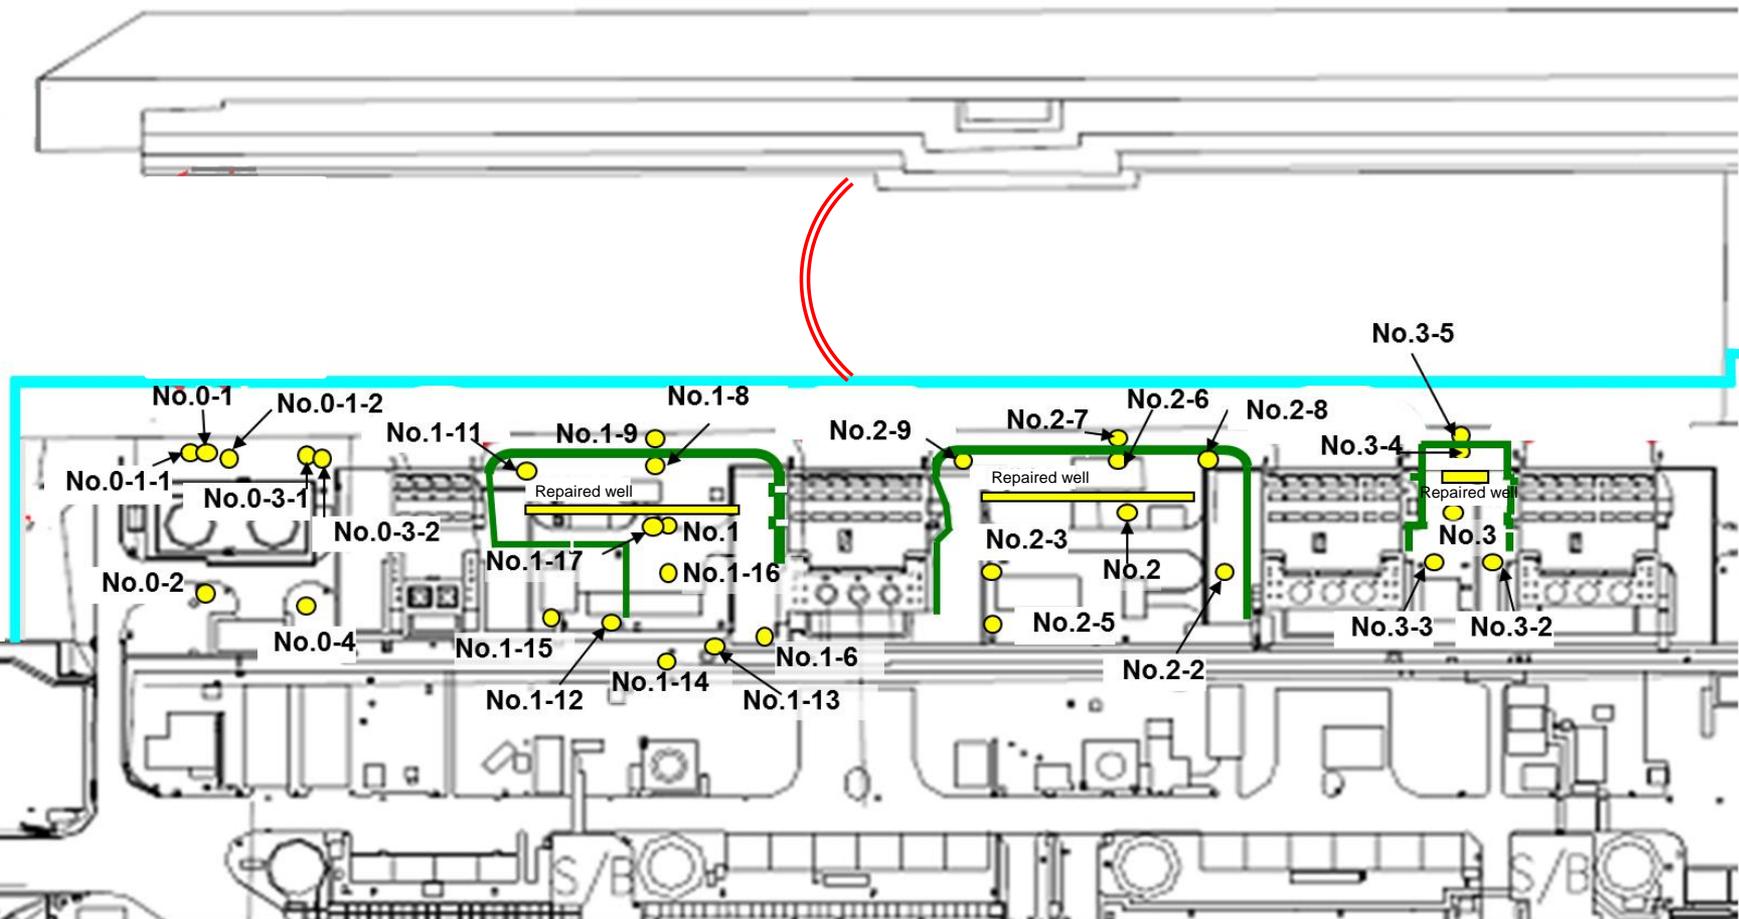

— Seaside impermeable wall

# Sampling places of seawater in the port and near drainage outlets at the Fukushima Daiichi Nuclear Power Station

Northeast of the port entrance

East of the port entrance

Southeast of the port entrance

- To monitor effects on the sea
- To monitor the radioactive concentration distribution in the port
- To monitor effects on the port

North of northern seawall

South of southern seawall


Port entrance

Eastern area in the port

Southern area in the port

Western area in the port

Central area in the port

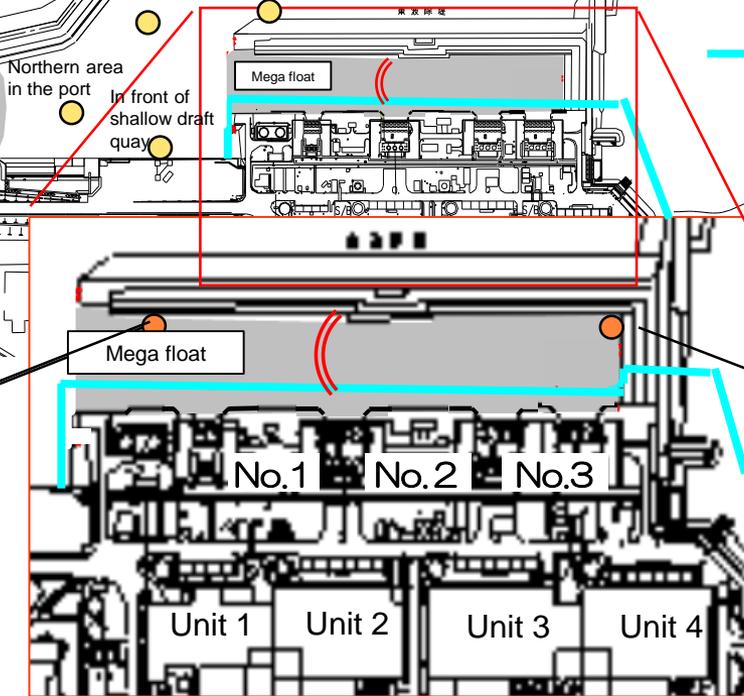

— : Seaside impermeable wall

※ In conjunction with the installation of the ALPS treated water dilution/discharge facilities and the completion of dredging work in the Unit 5/6 intake canal, etc., the seawater sampling place was changed from "In front of Unit 6 water intake" to "In front of Unit 5 water intake" on July 3, 2023 in accordance with the Implementation Plan.

North of Unit 5/6 drainage outlet

Near southern drainage outlet

Northern part of Unit 1-4 water intake canal (north of eastern wave breaker)

Southern part of Unit 1-4 water intake canal (in front of the impermeable wall)

Mega float

Mega float

In front of shallow draft quay

Northern area in the port

Unit 6 Unit 5

Unit 1 Unit 2 Unit 3 Unit 4

No.1 No.2 No.3

## Analysis Results of Groundwater Observation Holes Around the Bank Protection (Gross β [ · H-3] · γ · Chlorine)

(1/2)

Place of sampling	Date and Time of Sampling	Analysis Item								
		Gross β (Bq/L)	[H-3] [(Bq/L)]	Other γ nuclides				Cs-134 (Bq/L)	Cs-137 (Bq/L)	Chlorine (ppm)
				Mn-54 (Bq/L)	Co-60 (Bq/L)	Ru-106 (Bq/L)	Sb-125 (Bq/L)			
No. 0-1										
No. 0-1-2										
No. 0-2										
No. 0-3-1										
No. 0-3-2										
No. 0-4										
No. 1										
No. 1-6										
No. 1-8										
No. 1-9 <sup>※1</sup>										
No. 1-11										
No. 1-12										
No. 1-14										
No. 1-16										
No. 1-17										

· Half life of each nuclide: [H-3 (Approx. 12 years),] Mn-54 (Approx. 310 days), Co-60 (Approx. 5 years), Ru-106 (Approx. 370 days), Sb-125 (Approx. 3 years), Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)

· Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).

· “-” indicates that the item was not included in the measurement or the sampling was stopped.

· Values are expressed in exponential notation. For example, “3.1E+01” means “3.1×10<sup>1</sup>” and equals 31. Similarly, “3.1E+00” means “3.1×10<sup>0</sup>” and equals 3.1, and “3.1E-01” means “3.1×10<sup>-1</sup>” and equals 0.31.

[ · Analysis results except for H-3 have already been released.]

※1 As for No. 1-9, γ values were not measured because the water was sampled using a water sampler. Gross β was measured after filtration as a reference.

Analysis Results of Groundwater Observation Holes Around the Bank Protection  
(Gross β [ · H-3] · γ · Chlorine)

(2/2)

Place of Sampling	Date and Time of Sampling	Analysis Item								
		Gross β (Bq/L)	[H-3] [(Bq/L)]	Other γ nuclides				Cs-134 (Bq/L)	Cs-137 (Bq/L)	Chlorine (ppm)
				Mn-54 (Bq/L)	Co-60 (Bq/L)	Ru-106 (Bq/L)	Sb-125 (Bq/L)			
Water pumped up from Unit 1/2 well point										
No. 2										
No. 2-2										
No. 2-3										
No. 2-5 ※ <sup>2</sup>										
No. 2-6										
No. 2-7										
No. 2-8										
Water pumped up from Unit 2/3 repaired well										
No. 3										
No. 3-2										
No. 3-3										
No. 3-4										
No. 3-5 ※ <sup>2</sup>										
Water pumped up from Unit 3/4 repaired well										

· Half life of each nuclide: [H-3 (Approx. 12 years),] Mn-54 (Approx. 310 days), Co-60 (Approx. 5 years), Ru-106 (Approx. 370 days), Sb-125 (Approx. 3 years), Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)

· Inequality sign (<: less than) indicates that measurement result is less than the detection limit.

· “-” indicates that the item was not included in the measurement or the sampling was stopped.

· Values are expressed in exponential notation. For example, “3.1E+01” means “3.1×10<sup>1</sup>” and equals 31.

Similarly, “3.1E+00” means “3.1×10<sup>0</sup>” and equals 3.1, and “3.1E-01” means “3.1×10<sup>-1</sup>” and equals 0.31.

[ · Analysis results except for H-3 have already been released.]

※<sup>2</sup> As for No. 2-5 and No. 3-5, γ values were not measured because the water was sampled using a water sampler. Gross β was measured after filtration as a reference.

## Analysis Results of Groundwater Observation Holes Around the Bank Protection (Gross $\beta$ · H-3 · Sr · $\gamma$ · Chlorine)

Place of Sampling	Date and Time of Sampling	Analysis Item									
		Gross $\beta$ (Bq/L)	H-3 (Bq/L)	Sr-90 (Bq/L)	Other $\gamma$ nuclides				Cs-134 (Bq/L)	Cs-137 (Bq/L)	Chlorine (ppm)
					Mn-54 (Bq/L)	Co-60 (Bq/L)	Ru-106 (Bq/L)	Sb-125 (Bq/L)			
No. 1											
No. 1-6											
No. 1-8											
No. 1-9 ※ <sup>1</sup>											
No. 1-11											
No. 1-12											
No. 1-14											
No. 1-16											
No. 1-17											

• Half life of each nuclide: H-3 (Approx. 12 years), Sr-90 (Approx. 29 years), Mn-54 (Approx. 310 days), Co-60 (Approx. 5 years), Ru-106 (Approx. 370 days), Sb-125 (Approx. 3 years), Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)

• Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).

• "-" indicates that the item was not included in the measurement or the sampling was stopped.

• Values are expressed in exponential notation. For example, "3.1E+01" means "3.1×10<sup>1</sup>" and equals 31.

Similarly, "3.1E+00" means "3.1×10<sup>0</sup>" and equals 3.1, and "3.1E-01" means "3.1×10<sup>-1</sup>" and equals 0.31.

• Analysis results except for Sr-90 have already been released.

※<sup>1</sup> As for No. 1-9,  $\gamma$  values were not measured because the water was sampled using a water sampler. Gross  $\beta$  was measured after filtration as a reference.

[Date]

Tokyo Electric Power Company Holdings, Inc.  
Fukushima Daiichi D&D Engineering Company

### Analysis Results of Seawater

<In the Port, near Drainage Outlets> (Gross  $\beta$  [ · H-3 ] ·  $\gamma$ )

Place of Sampling	Date and Time of Sampling	Analysis Item			
		Gross $\beta$ (Bq/L)	[ H - 3 ] [(Bq/L)]	Cs-134 (Bq/L)	Cs-137 (Bq/L)
North of Unit 5/6 Drainage Outlet (T-1), 1F					
In front of Unit 6 Water Intake, 1F					
In front of Shallow Draft Quay, 1F					
Northern Part of Unit 1-4 Water Intake Canal (North of Eastern Wave Breaker), 1F					
Southern Part of Unit 1-4 Water Intake Canal (In front of the Impermeable Wall), 1F					
Near Southern Drainage Outlet (T-2), 1F					
Port Entrance (T-0), 1F					
Central Area in the Port, 1F					
Eastern Area in the Port, 1F					
Western Area in the Port, 1F					
Northern Area in the Port, 1F					
Southern Area in the Port, 1F					
North of Northern Seawall (T-0-1), 1F					
Northeast of the Port Entrance (T-0-1A), 1F					
East of the Port Entrance (T-0-2), 1F					
Southeast of the Port Entrance (T-0-3A), 1F					
South of Southern Seawall (T-0-3), 1F					
WHO Guidelines for Drinking-water Quality <sup>*1</sup>			1.0E+04	1.0E+01	1.0E+01

· Half life of each nuclide: [H-3 (Approx. 12 years),] Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)

· Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).

· “-” indicates that the item was not included in the measurement or the sampling was stopped.

· Values are expressed in exponential notation. For example, “3.1E+01” means “3.1×10<sup>1</sup>” and equals 31.

Similarly, “3.1E+00” means “3.1×10<sup>0</sup>” and equals 3.1, and “3.1E-01” means “3.1×10<sup>-1</sup>” and equals 0.31.

· On such a day when silt fence is opened/closed, sampling in front of shallow draft quay is conducted also after the opening/closing.

[ · Analysis results except for H-3 have already been released.]

\*1 Guideline levels for [H-3, ]Cs-134 and Cs-137 in WHO Guidelines for Drinking-water Quality

· For the evaluation of the analysis results, please refer to the “Status of the Fukushima Daiichi NPS (Daily Report)” (in Japanese only) .

<https://www.tepco.co.jp/press/report/>

New Form\*

[Date]

\*"In front of Unit 6 Water Intake, 1F" was changed to "In front of Unit 5 Water Intake, 1F" for sampling conducted on and after July 3, 2023.

Tokyo Electric Power Company Holdings, Inc.  
Fukushima Daiichi D&D Engineering Company

**Analysis Results of Seawater**  
**<In the Port, near Drainage Outlets> (Gross  $\beta$  [· H-3] ·  $\gamma$ )**

Place of Sampling	Date and Time of Sampling	Analysis Item			
		Gross $\beta$ (Bq/L)	[H-3] [(Bq/L)]	Cs-134 (Bq/L)	Cs-137 (Bq/L)
North of Unit 5/6 Drainage Outlet (T-1), 1F					
In front of Unit 5 Water Intake, 1F					
In front of Shallow Draft Quay, 1F					
Northern Part of Unit 1-4 Water Intake Canal (North of Eastern Wave Breaker), 1F					
Southern Part of Unit 1-4 Water Intake Canal (In front of the Impermeable Wall), 1F					
Near Southern Drainage Outlet (T-2), 1F					
Port Entrance (T-0), 1F					
Central Area in the Port, 1F					
Eastern Area in the Port, 1F					
Western Area in the Port, 1F					
Northern Area in the Port, 1F					
Southern Area in the Port, 1F					
North of Northern Seawall (T-0-1), 1F					
Northeast of the Port Entrance (T-0-1A), 1F					
East of the Port Entrance (T-0-2), 1F					
Southeast of the Port Entrance (T-0-3A), 1F					
South of Southern Seawall (T-0-3), 1F					
WHO Guidelines for Drinking-water Quality <sup>※1</sup>	/	1.0E+04	1.0E+01	1.0E+01	

- Half life of each nuclide: [H-3 (Approx. 12 years),] Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)
- Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).
- "-" indicates that the item was not included in the measurement or the sampling was stopped.
- Values are expressed in exponential notation. For example, "3.1E+01" means "3.1×10<sup>1</sup>" and equals 31. Similarly, "3.1E+00" means "3.1×10<sup>0</sup>" and equals 3.1, and "3.1E-01" means "3.1×10<sup>-1</sup>" and equals 0.31.
- On such a day when silt fence is opened/closed, sampling in front of shallow draft quay is conducted also after the opening/closing.
- [ · Analysis results except for H-3 have already been released.]
- ※1 Guideline levels for [H-3, ]Cs-134 and Cs-137 in WHO Guidelines for Drinking-water Quality
- For the evaluation of the analysis results, please refer to the "Status of the Fukushima Daiichi NPS (Daily Report)" (*in Japanese only*) .  
<https://www.tepco.co.jp/press/report/>

Analysis Results of Seawater  
<In the Port, near Drainage Outlets> (Gross  $\beta$  ·  $\gamma$ )

Place of Sampling	Date and Time of Sampling	Analysis Item		
		Gross $\beta$ (Bq/L)	Cs-134 (Bq/L)	Cs-137 (Bq/L)
In front of Shallow Draft Quay, 1F (after opening/closing silt fence)				
Concentration Limit Required by Law ※ <sup>1</sup>		/	6.0E+01	9.0E+01
WHO Guidelines for Drinking-water Quality		/	1.0E+01	1.0E+01

- Half life of each nuclide: Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)
- Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).
- “-” indicates that the item was not included in the measurement or the sampling was stopped.
- Values are expressed in exponential notation. For example, “3.1E-01” means “ $3.1 \times 10^{-1}$ ” and equals 0.31. Similarly, “3.1E+00” means “ $3.1 \times 10^0$ ” and equals 3.1, and “3.1E-01” means “ $3.1 \times 10^{-1}$ ” and equals 0.31.
- On such a day when silt fence is opened/closed, sampling in front of shallow draft quay is conducted also after the opening/closing.

※ 1 Concentration limit specified by the Regulation Concerning the Security of the Reactor Facilities at the Fukushima Daiichi Nuclear Power Station and the Protection of Specific Nuclear Fuel Material  
(the concentration limit in the water outside of surrounding monitored areas in the section 6 of the appendix 1:  
Limit specified by the Regulation is converted from Bq/cm<sup>3</sup> to Bq/L in the table.)

[Date]

Tokyo Electric Power Company Holdings, Inc.  
Fukushima Daiichi D&D Engineering Company

### Analysis Results of Seawater

#### <In the Port, near Drainage Outlets> (Gross $\beta$ · H-3 · Sr · $\gamma$ )

Place of Sampling	Date and Time of Sampling	Analysis Item				
		Gross $\beta$ (Bq/L)	H-3 (Bq/L)	Sr-90 (Bq/L)	Cs-134 (Bq/L)	Cs-137 (Bq/L)
North of Unit 5/6 Drainage Outlet (T-1), 1F						
In front of Shallow Draft Quay, 1F						
Northern Part of Unit 1-4 Water Intake Canal (North of Eastern Wave Breaker), 1F						
Southern Part of Unit 1-4 Water Intake Canal (In front of the Impermeable Wall), 1F						
Near Southern Drainage Outlet (T-2), 1F						
Port Entrance (T-0), 1F						
Central Area in the Port, 1F						
Northern Area in the Port, 1F						
WHO Guidelines for Drinking-water Quality <sup>※1</sup>			1.0E+04	1.0E+01	1.0E+01	1.0E+01

- Half life of each nuclide: H-3 (Approx. 12 years), Sr-90 (Approx. 29 years), Cs-134 (Approx. 2 years), Cs-137 (Approx. 30 years)
  - Inequality sign (<: less than) indicates that measurement result is less than the detection limit (ND).
  - “-” indicates that the item was not included in the measurement or the sampling was stopped.
  - Values are expressed in exponential notation. For example, “3.1E+01” means “3.1×10<sup>1</sup>” and equals 31. Similarly, “3.1E+00” means “3.1×10<sup>0</sup>” and equals 3.1, and “3.1E-01” means “3.1×10<sup>-1</sup>” and equals 0.31.
  - On such a day when silt fence is opened/closed, sampling in front of shallow draft quay is conducted also before the opening/closing.
  - Nuclides analysis results except for Sr-90 have already been released.
- ※ 1 Guideline levels for H-3, Sr-90, Cs-134 and Cs-137 in WHO Guidelines for Drinking-water Quality
- For the evaluation of the analysis results, please refer to the “Status of the Fukushima Daiichi NPS (Daily Report)” (*in Japanese only*).  
<https://www.tepco.co.jp/press/report/>

<Reference> The Highest Dose Until the Previous Release (Groundwater Around the Bank Protection)

Unit : Bq/L

	Groundwater Observation Hole No. 0-1	Groundwater Observation Hole No. 0-1-1	Groundwater Observation Hole No. 0-1-2	Groundwater Observation Hole No. 0-2	Groundwater Observation Hole No. 0-3-1	Groundwater Observation Hole No. 0-3-2	Groundwater Observation Hole No. 0-4	Groundwater Observation Hole No. 1	Groundwater Observation Hole No. 1-1*	Groundwater Observation Hole No. 1-2*	Groundwater Observation Hole No. 1-3*	Groundwater Observation Hole No. 1-4*	Groundwater Observation Hole No. 1-5*	Groundwater Observation Hole No. 1-6
Cs-134 (Approx. 2 years)														
Cs-137 (Approx. 30 years)														
The other γ	Ru-106 (Approx. 370 days)													
	Mn-54 (Approx. 310 days)													
	Co-60 (Approx. 5 years)													
	Sb-125 (Approx. 3 years)													
Gross β														
H-3 (Approx. 12 years)														
Sr-90 (Approx. 29 years)														

Unit : Bq/L

	Groundwater Observation Hole No. 1-8	Groundwater Observation Hole No. 1-9	Groundwater Observation Hole No. 1-10	Groundwater Observation Hole No. 1-11	Groundwater Observation Hole No. 1-12	Groundwater Observation Hole No. 1-13	Groundwater Observation Hole No. 1-14	Groundwater Observation Hole No. 1-15	Groundwater Observation Hole No. 1-16	Groundwater Observation Hole No. 1-17	Water pumped up from Unit 1/2 well point	Groundwater Observation Hole No. 2	Groundwater Observation Hole No. 2-1*	Groundwater Observation Hole No. 2-2
Cs-134 (Approx. 2 years)														
Cs-137 (Approx. 30 years)														
The other γ	Ru-106 (Approx. 370 days)													
	Mn-54 (Approx. 310 days)													
	Co-60 (Approx. 5 years)													
	Sb-125 (Approx. 3 years)													
Gross β														
H-3 (Approx. 12 years)														
Sr-90 (Approx. 29 years)														

Unit : Bq/L

	Groundwater Observation Hole No. 2-3	Groundwater Observation Hole No. 2-5	Groundwater Observation Hole No. 2-6	Groundwater Observation Hole No. 2-7	Groundwater Observation Hole No. 2-8	Groundwater Observation Hole No. 2-9	Water pumped up from Unit 2/3 repaired well**1	Groundwater Observation Hole No. 3	Groundwater Observation Hole No. 3-1*	Groundwater Observation Hole No. 3-2	Groundwater Observation Hole No. 3-3	Groundwater Observation Hole No. 3-4	Groundwater Observation Hole No. 3-5	Water pumped up from Unit 3/4 repaired well**1
Cs-134 (Approx. 2 years)														
Cs-137 (Approx. 30 years)														
The other γ	Ru-106 (Approx. 370 days)													
	Mn-54 (Approx. 310 days)													
	Co-60 (Approx. 5 years)													
	Sb-125 (Approx. 3 years)													
Gross β														
H-3 (Approx. 12 years)														
Sr-90 (Approx. 29 years)														

● The highest dose among the data that have been released is shown for Strontium-90, since some samples are still under analysis.

\* 1 Analysis results of pumped up water

\* 2 Reference value because of high turbidity (Measurement was conducted after filtration.)

※ Observation holes where sampling cannot be conducted currently due to effects of chemical injection in conjunction with soil improvement

(Note) As for No. 1-9, 2-5 and 3-5, γ values were not measured because the water was sampled using a water sampler. Gross β was measured after filtration as a reference.

\* ND indicates that measurement result is less than the detection limit.

\* The sampling date is provided in parenthesis.

※1 Sample name was changed as the pumping method was altered.

※2 Corrected on November 25, 2021, since there was an omission in updating the highest value.

※3 Sampling date was corrected from May 15, 2020 to May 25, 2020 on September 6, 2022.

• Values are expressed in exponential notation. For example, "3.1E+01" means "3.1×10<sup>1</sup>" and equals 31. Similarly, "3.1E+00" means "3.1×10<sup>0</sup>" and equals 3.1, and "3.1E-01" means "3.1×10<sup>-1</sup>" and equals 0.31.

<Reference> The Highest Dose Until the Previous Release ※<sup>1</sup> (Seawater)

Unit: Bq/L

	North of Unit 5/6 Drainage Outlet, 1F	In front of Unit 5 Water Intake, 1F ※ <sup>3</sup>	In front of Shallow Draft Quay, 1F	Northern part of Unit 1- 4 Water Intake Canal (North of Eastern Wave Breaker), 1F	In front of Unit 1 Water Intake (In front of the Impermeable wall), 1F	In front of Unit 2 Water Intake (In front of the Impermeable wall), 1F	In front of Unit 3/4 Water Intake, 1F	Unit 4 Screen (Inside the silt fence), 1F	Southern Part of Unit 1- 4 Intake Canal (In front of the impermeable wall), 1F	Near Southern Drainage Outlet, 1F	Port Entrance, 1F
Cs-134 (Approx. 2 years)											
Cs-137 (Approx. 30 years)											
Gross β											
H-3 (Approx. 12 years)											
Sr-90 (Approx. 29 years)											

Unit: Bq/L

	Eastern Area in the Port, 1F	Western Area in the Port, 1F	Northern Area in the Port, 1F	Southern Area in the Port, 1F	Central Area in the Port, 1F	North of Northern Seawall, 1F	Northeast of the Port Entrance, 1F	East of the Port Entrance, 1F	Southeast of the Port Entrance, 1F	South of Southern Seawall, 1F
Cs-134 (Approx. 2 years)										
Cs-137 (Approx. 30 years)										
Gross β										
H-3 (Approx. 12 years)										
Sr-90 (Approx. 29 years)										

※<sup>1</sup> "Northern part of Unit 1-4 water intake canal" is for sampling conducted on and after January 14, 2013. The others are for sampling conducted on and after June 14, 2013.

The highest dose among the data that have been released is shown for Strontium-90, since some samples are still under analysis.

※<sup>2</sup> Corrected on November 25, 2021 in conjunction with a revision of highest dose management operation.

※<sup>3</sup> In conjunction with the installation of the ALPS treated water dilution/discharge facilities and the completion of dredging work in the Unit 5/6 intake canal, etc., the seawater sampling place was changed from "In front of Unit 6 water intake" to "In front of Unit 5 water intake" on July 3, 2023 in accordance with the Implementation Plan.

• Values are expressed in exponential notation. For example, "3.1E+01" means "3.1×10<sup>1</sup>" and equals 31. Similarly, "3.1E+00" means "3.1×10<sup>0</sup>" and equals 3.1, and "3.1E-01" means "3.1×10<sup>-1</sup>" and equals 0.31.

\* ND indicates that measurement result is less than the detection limit.

\* The sampling date is provided in parenthesis.

\* "-" indicates that the item was not included in the measurement.

【Reference】 Concentration limit

Unit: Bq/L

	Cs-134	Cs-137	H-3	Sr-90
Concentration limit specified by the Regulation Concerning the Security of the Reactor Facilities at the Fukushima Daiichi Nuclear Power Station and the Protection of Specific Nuclear Fuel Material (the concentration limit in the water outside of surrounding monitored areas in the section 6 of the appendix 1: Limit specified by the Regulation is converted from Bq/cm <sup>3</sup> to Bq/L in this table.)	6.0E+01	9.0E+01	6.0E+04	3.0E+01
WHO Guidelines for Drinking-water Quality	1.0E+01	1.0E+01	1.0E+04	1.0E+01