

## Nuclide Analysis Results of Radioactive Materials in Seawater <Coast>

Reference

(Data summarized on February 4)

Place of Sampling	North of Discharge Channel of 5-6u of 1F (approx. 30m north of 5-6u discharge channel)	Around South Discharge Channel of 1F ( approx. 330m south of 1-4u Discharge Channel)	Around North Discharge Channel of 2F ( Around 3,4u Discharge Channel) ( approx. 10 km from 1F )	Around Iwasawa Shore of 2F ( approx. 7 km south of 1,2u Discharge Channel) ( approx. 16 km from 1F )	Density limit by the announcement of Reactor Regulation (Bq/L)  (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)				
Time of Sampling	Feb 03, 2012 08:45 am	Feb 03, 2012 08:30 am	Feb 03, 2012 08:25 am	Feb 03, 2012 08:05 am					
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor ( / )	Density of Sample (Bq/L)	Scaling Factor ( / )					
I-131 (about 8 days)	ND	-	ND	-	ND	-	ND	-	40
Cs-134 (about 2 years)	ND	-	1.1	0.02	0.99	0.02	1.2	0.02	60
Cs-137 (about 30 years)	1.5	0.02	1.9	0.02	2.1	0.02	1.5	0.02	90

\* Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides are under evaluation.

\* In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

\* "ND" means the sampled data is below measurable limit.

I-131: approx. 0.71Bq/L, Cs-134: approx. 0.87Bq/L

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.

Data of offshore were not taken due to bad weather.

## Nuclide Analysis Results of Radioactive Materials in Seawater < offshore re-examination >

Reference

Data summarized: Feb. 04, 2012

Place of Sampling	15 km offshore of Fukushima Daiichi Upper Layer		15 km offshore of Fukushima Daini Upper Layer		Density limit by the announcement of Reactor Regulation (Bq/L) (the density limit in the water outside of surrounding monitored areas in the section 6 of the appendix 2)
Time of Sampling	Feb 01, 2012 09:25 am		Feb 01, 2012 08:50 am		
Detected Nuclides (Half-life)	Density of Sample (Bq/L)	Scaling Factor ( / )	Density of Sample (Bq/L)	Scaling Factor ( / )	
I-131 (about 8 days)	ND	-	ND	-	40
Cs-134 (about 2 years)	ND	-	ND	-	60
Cs-137 (about 30 years)	ND	-	ND	-	90
Mn-54 (approx.310days)	ND	-	ND	-	1,000
Co-60 (approx.5yrs)	ND	-	ND	-	200
Ce-144 (approx. 280 days)	ND	-	ND	-	200

\* Density by the announcement of Reactor Regulation is stated with an amount converted from Bq/cm<sup>3</sup> to Bq/L.

\* Data of other nuclides are under evaluation.


\* In the case that two or more kinds of nuclides exist, sum of each scaling factor to the density limit is compared with 1.

\* "ND" means the sampled data is below measurable limit.


I-131: approx. 0.17Bq/L, Cs-134: approx. 0.27Bq/L, Cs-137: approx. 0.32Bq/L, Mn-54: approx. 0.13Bq/L, Co-60 : approx. 0.12Bq/L, Ce-144 : approx 0.92Bq/L

Please note that these nuclides are sometimes detected even when they are below the limits, contingent on the detector or samples.


# Radioactivity Density of Seawater (Bq/L)

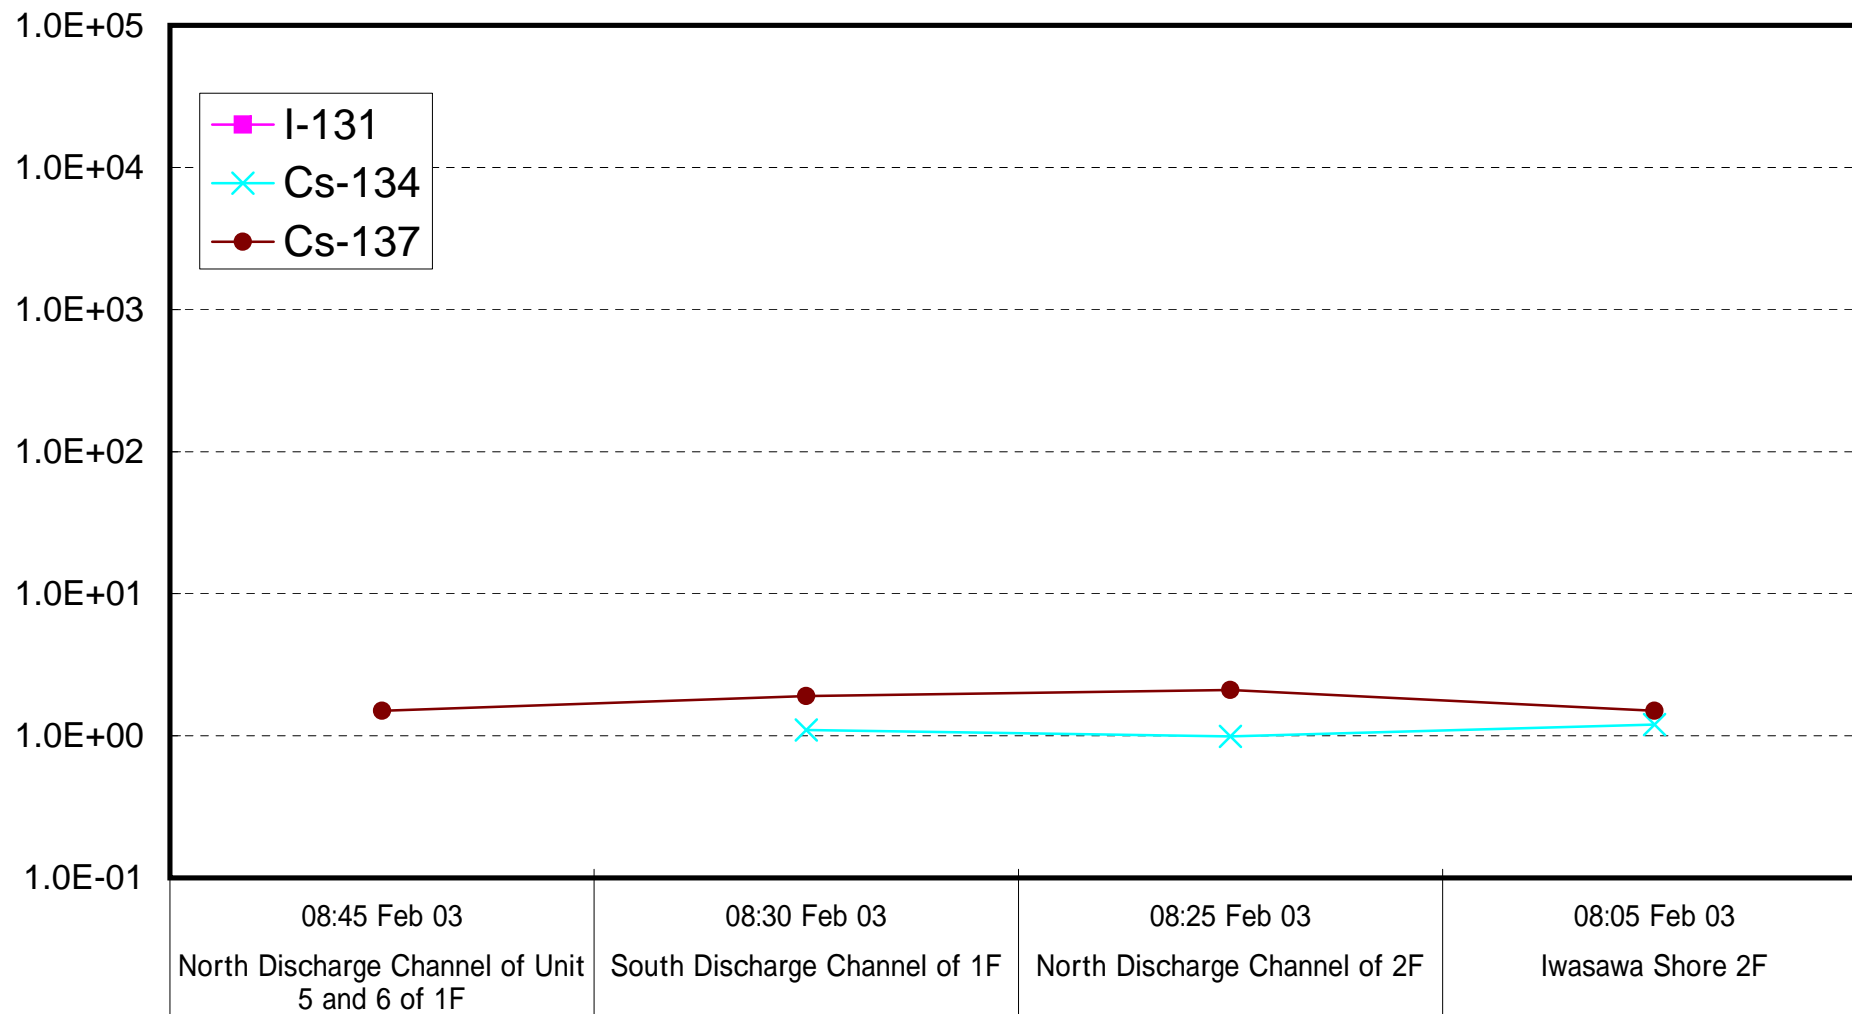


Radioactivity Density of Seawater at North of 1F5-6 Discharge Channel (Bq/L)

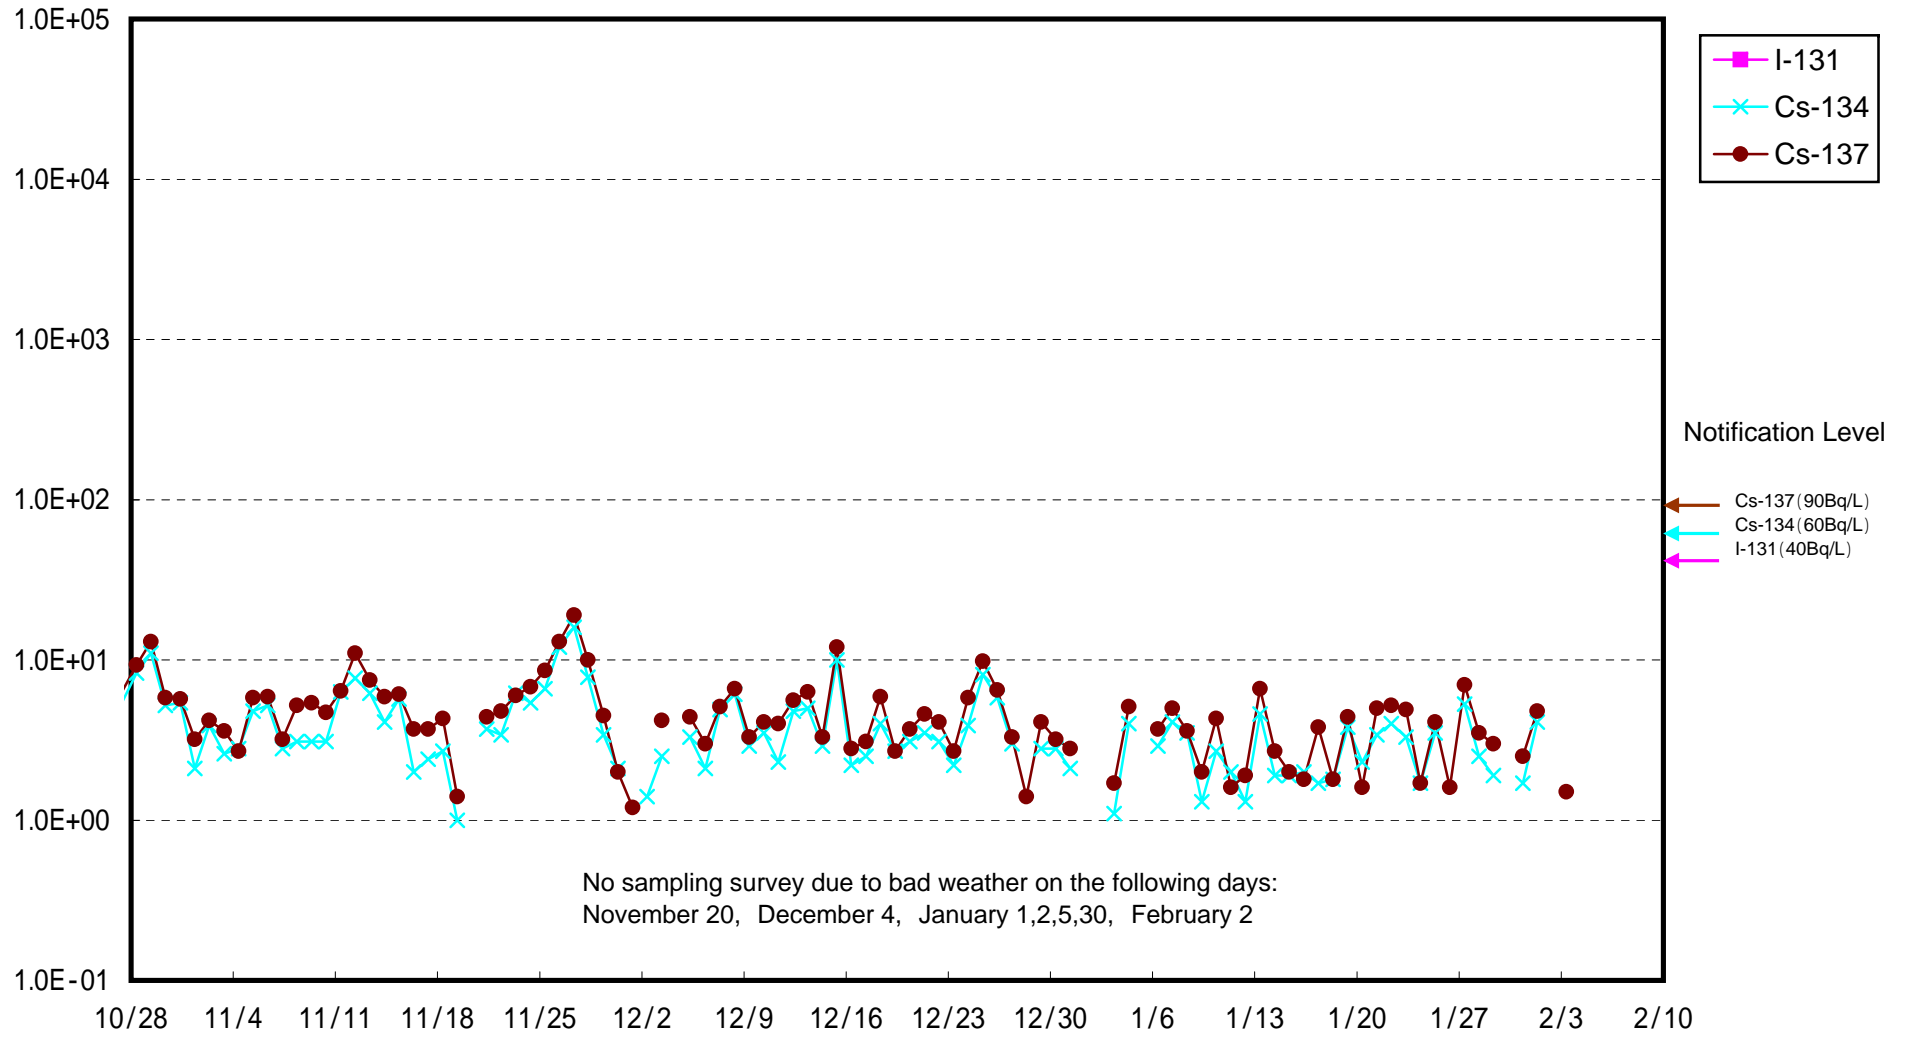


Radioactivity Density of Seawater at South Discharge Channel of 1F (Bq/L)

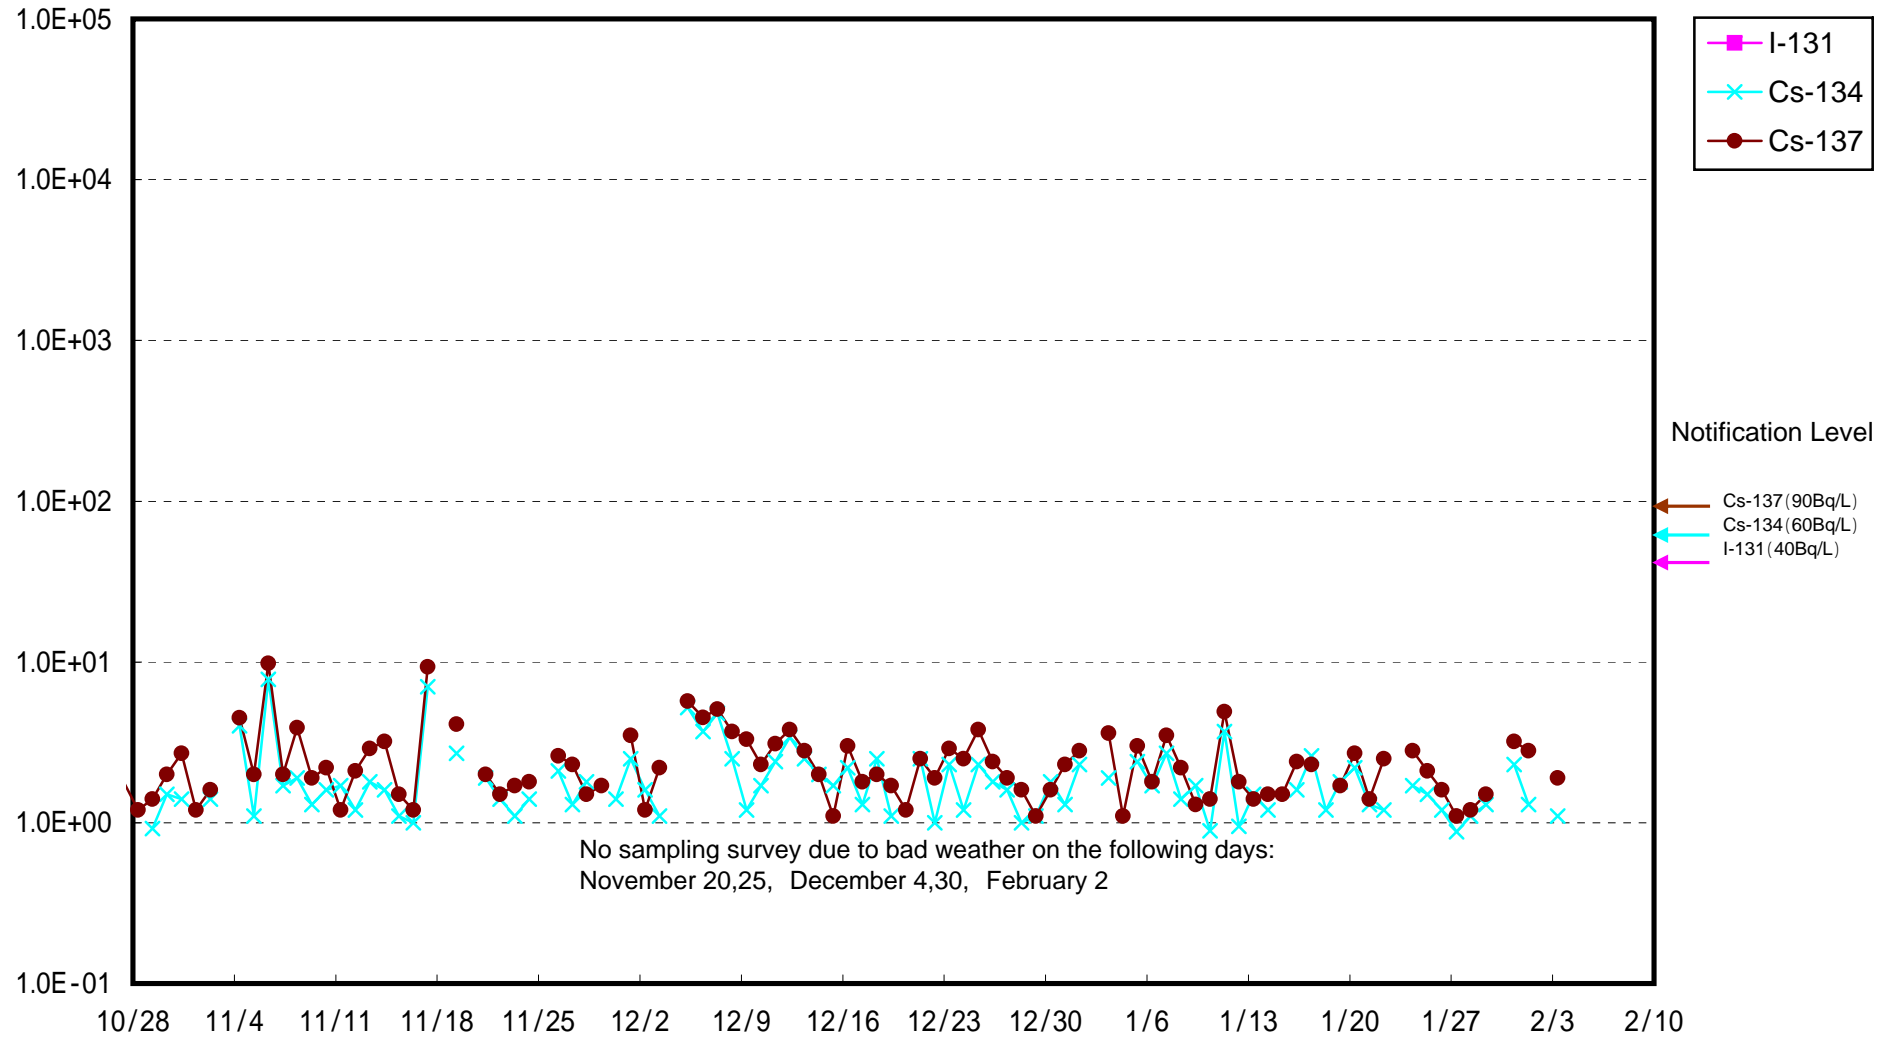


Radioactivity Density of Seawater at North Discharge Channel of 2F (Bq/L)

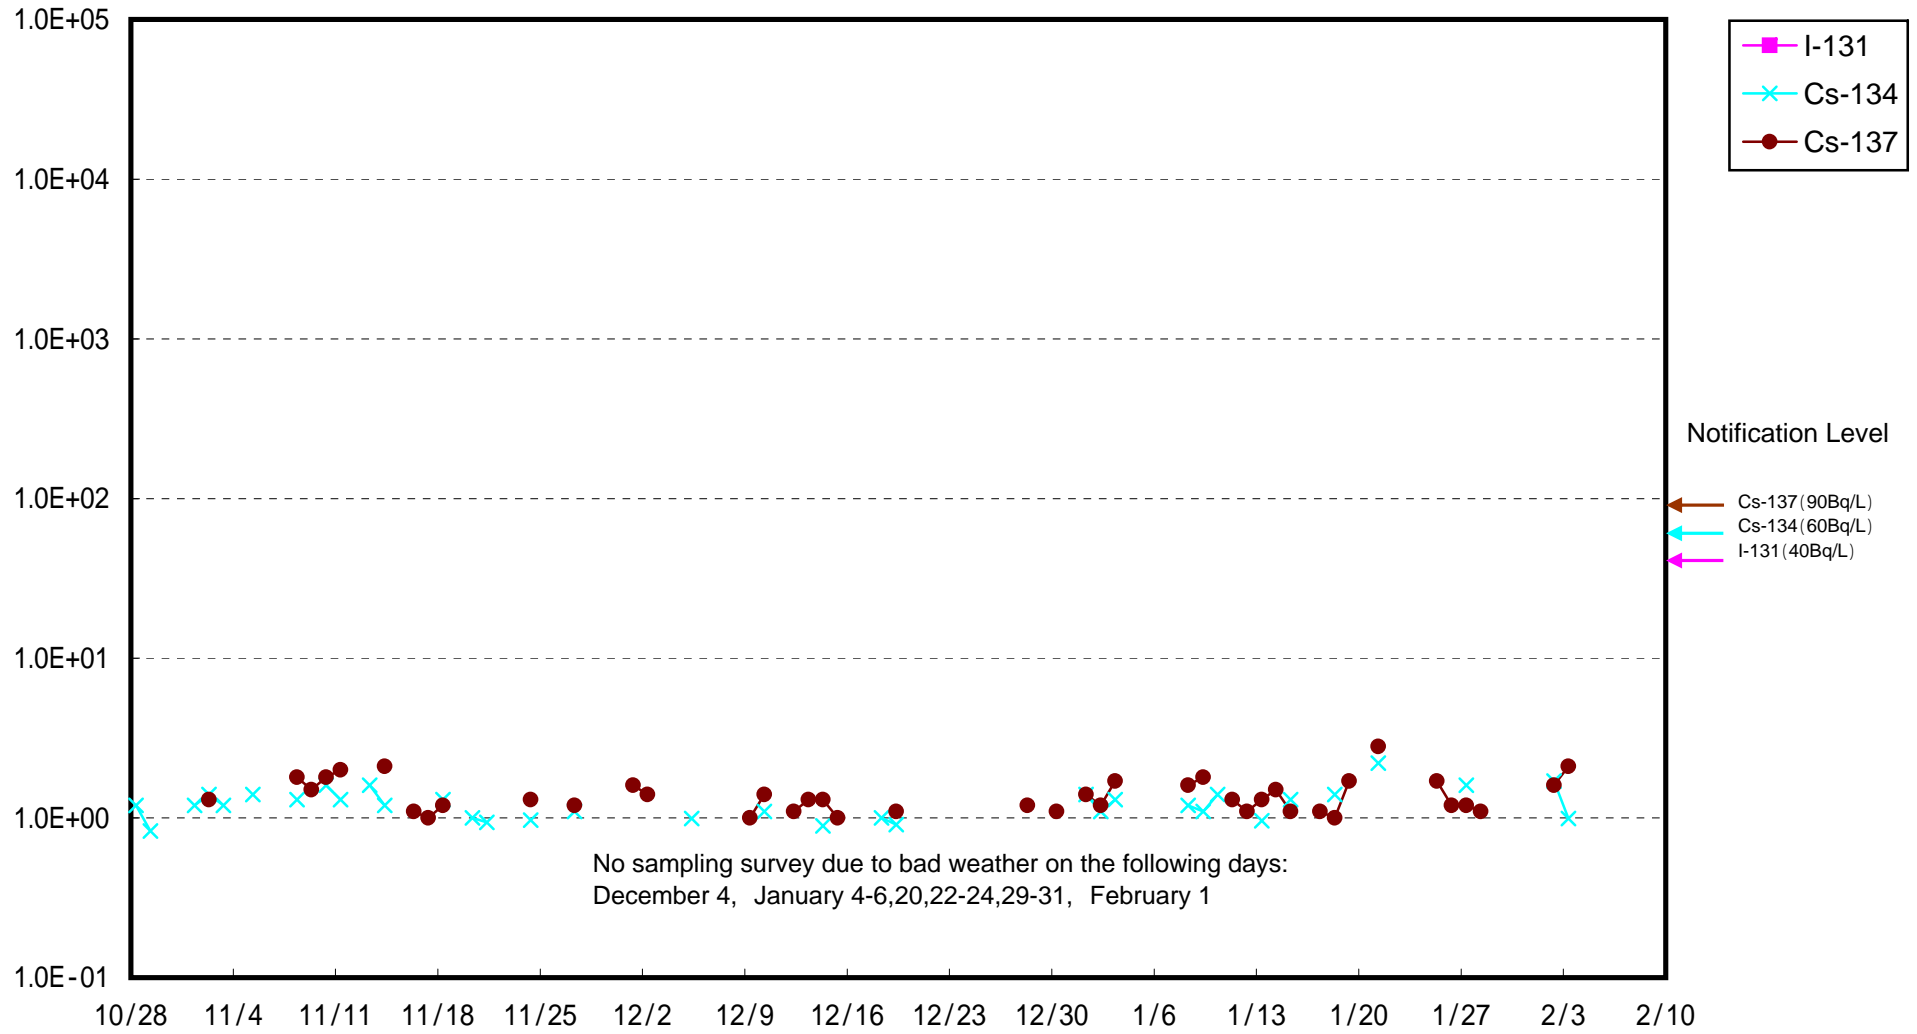

Radioactivity Density of Seawater at Iwasawa Shore 2F (Bq/L)

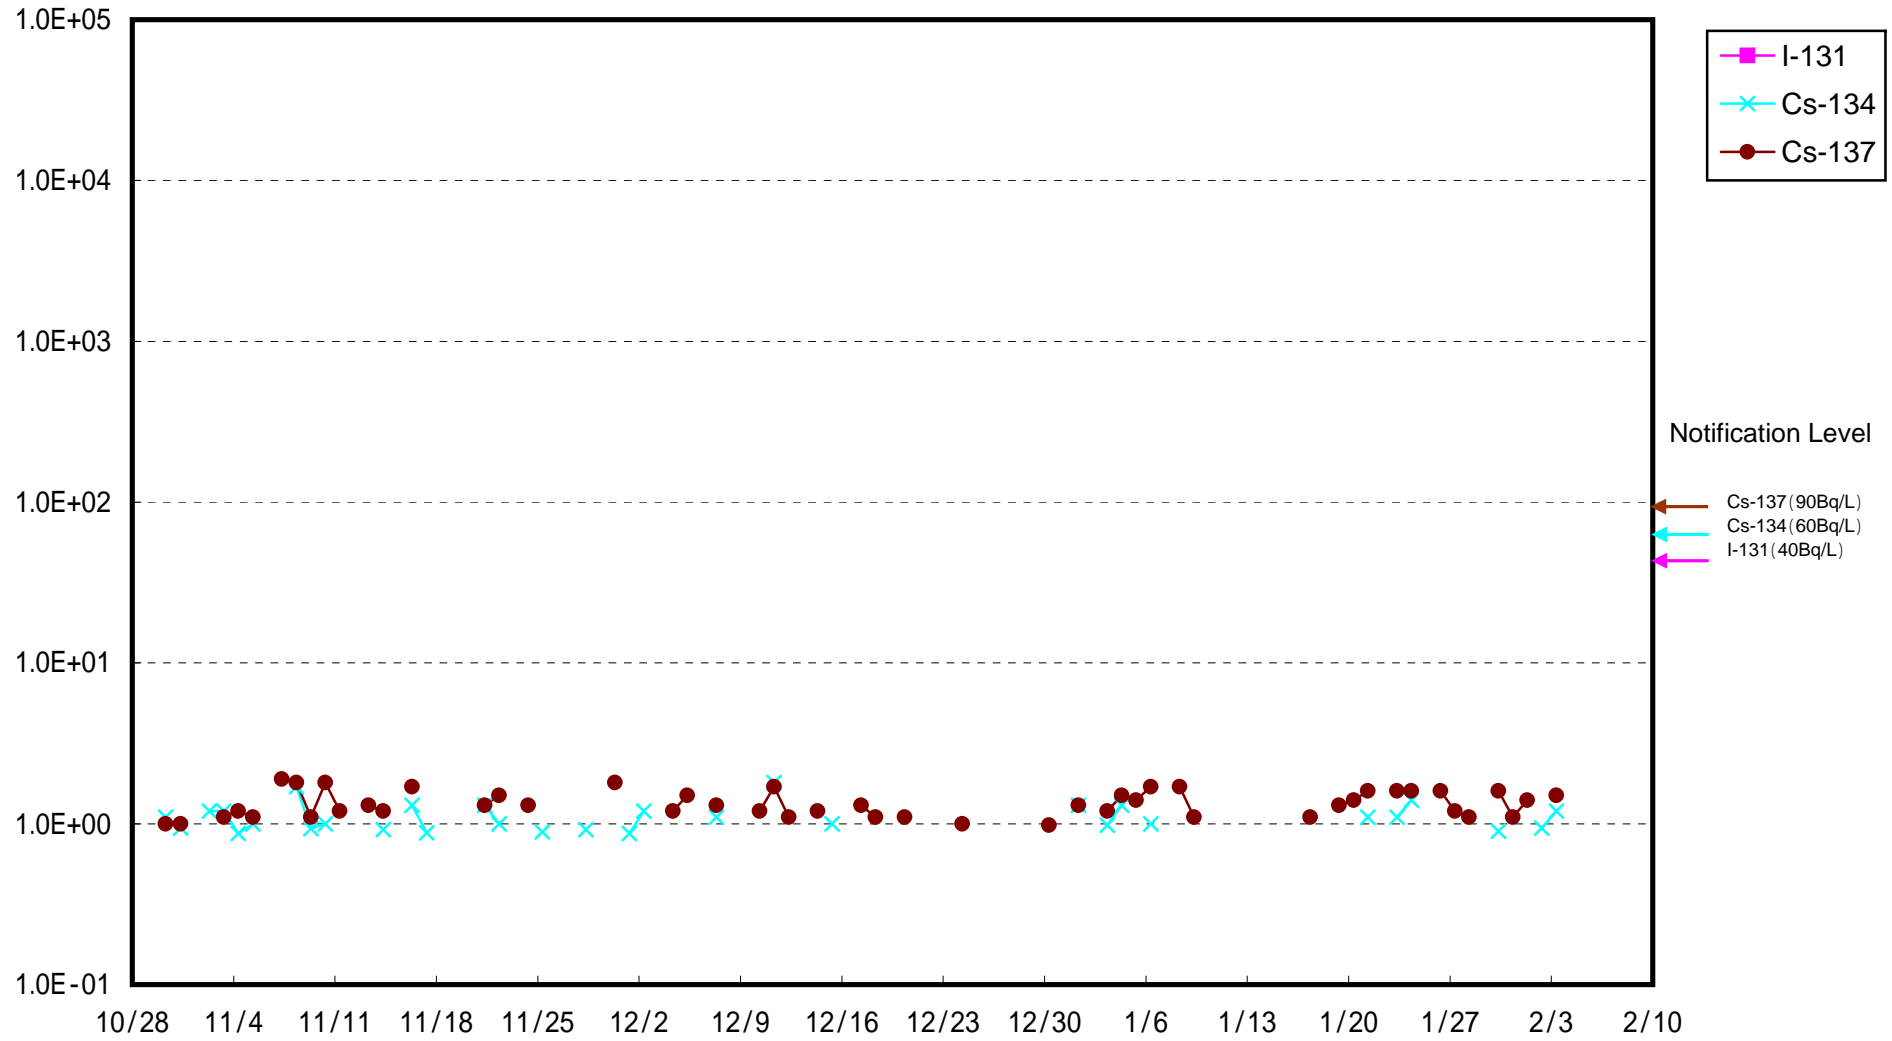

Radioactivity Density of Seawater 15km offshore of Fukushima Daiichi NPS Upper Layer Re-examination  
(Bq/L)

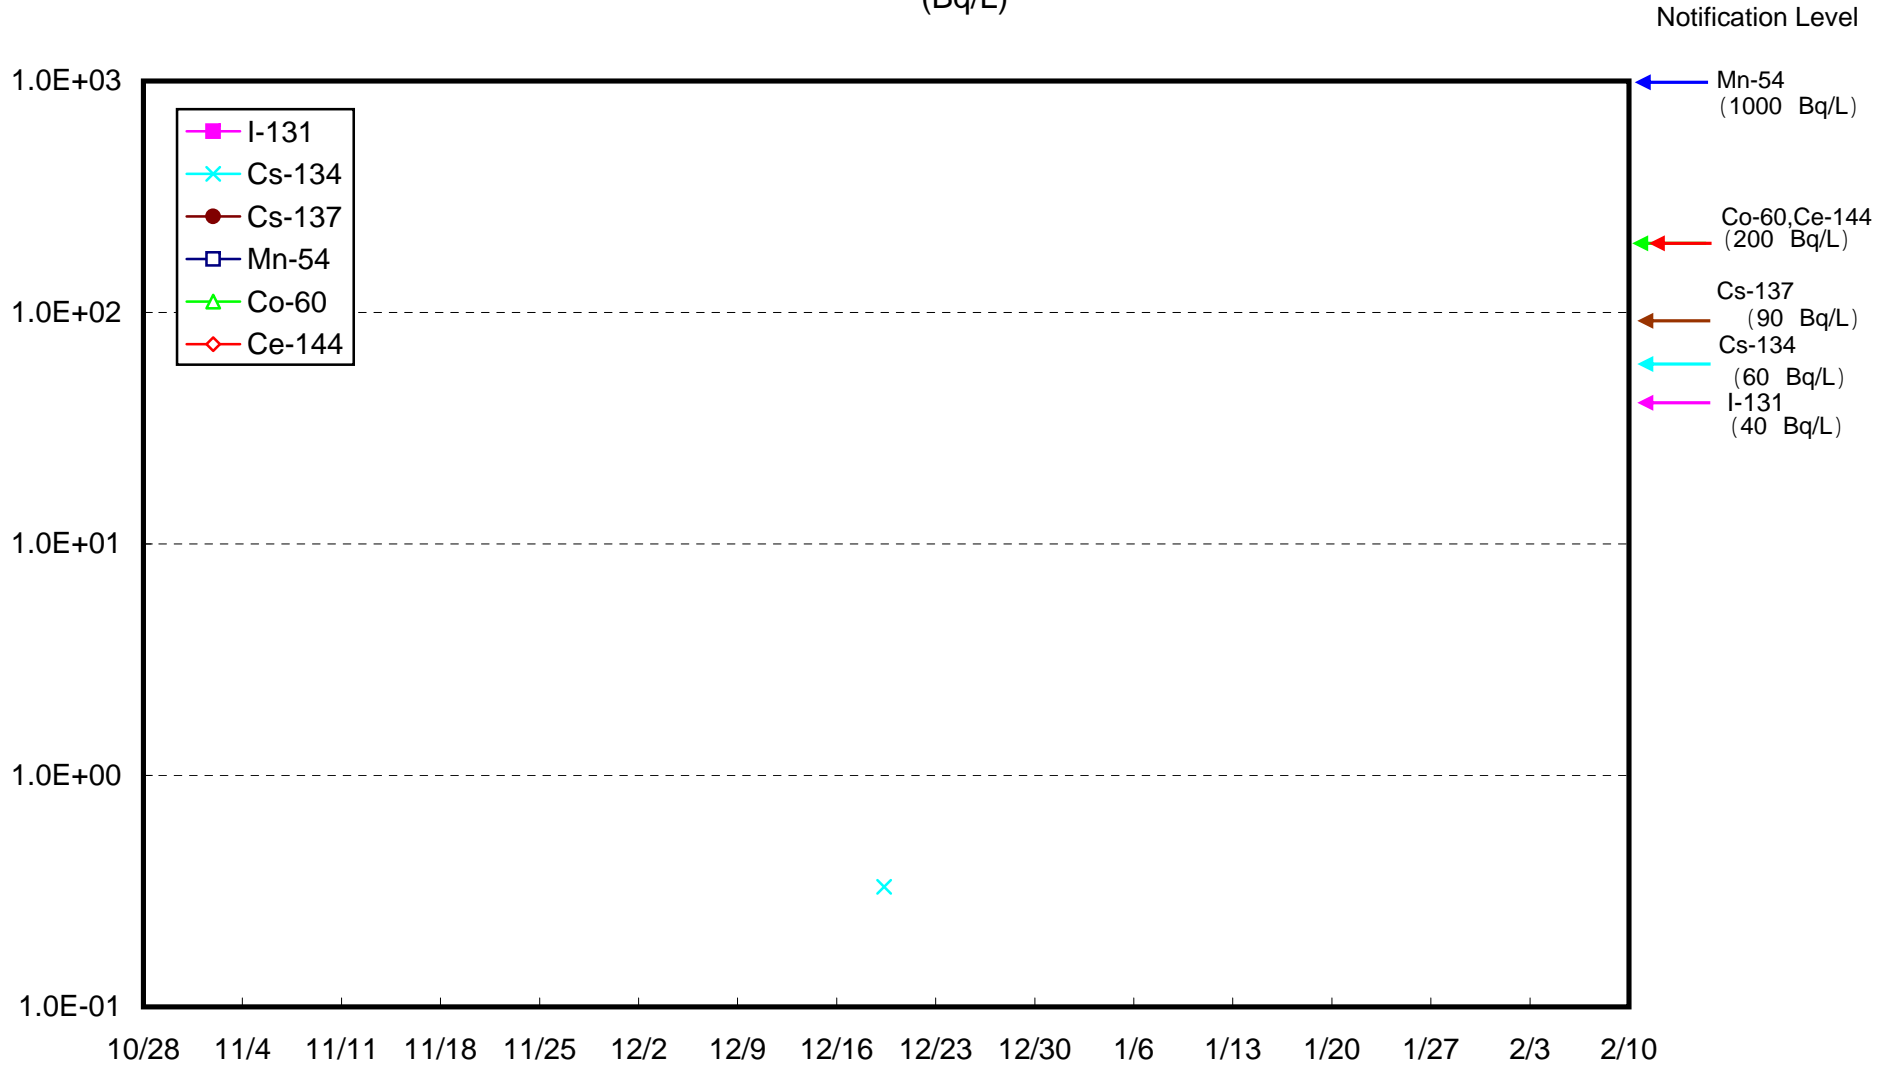



Radioactivity Density of Seawater 15km offshore of Fukushima Daini NPS Upper Layer Re-examination  
(Bq/L)

