
Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Underground Water Obtained at Bank Protection)

O Sampling locations of underground water obtained at bank

### East seawall break

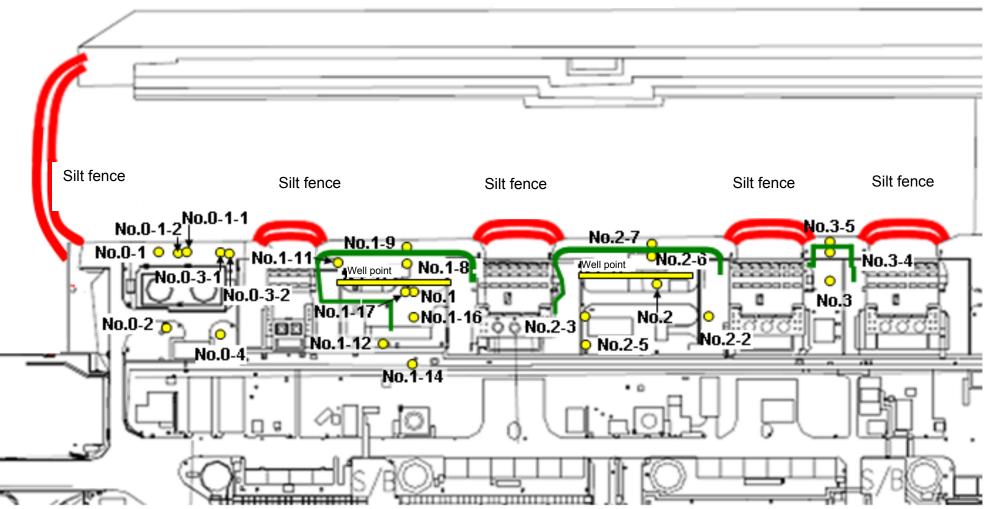

Elocation where ground improvement construction was completed, or being implemented (as of December 27)

## Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (1/4) Underground Water Obtained at Bank Protection

Unit: Bq/L (exclude chloride)

														Unit: Bq/L (	exclude chloride)
		Underground water observation hole No.0-1	Underground water observation hole No.0-1-1	Underground water observation hole No.0-1-2	Underground water observation hole No.0-2	Underground water observation hole No.0-3-1	Underground water observation hole No.0-3-2	Underground water observation hole No.0-4	Underground water observation hole No.1	Underground water observation hole No.1-8	Underground water observation hole No.1-9	Underground water observation hole No.1-11	Underground water observation hole No.1-12	Underground water observation hole No.1-14	Underground water observation hole No.1-16
	Date of sampling	/	/	1 /	/	/	/	/	Jan 09, 2014	/	/	Jan 09, 2014	Jan 09, 2014	Jan 09, 2014	Jan 09, 2014
	Time of sampling				/				10:25 AM			9:10 AM	9:21 AM	9:42 AM	9:51 AM
	Chloride (unit: ppm)								-			-	-	-	-
(	Cs-134 (Approx. 2 years)								ND(0.40)			0.76	4.6	-	ND(3.3)
C	cs-137 (Approx.30 years)								ND(0.52)			1.3	11	-	ND(1.7)
	Co-60 (Approx. 5 years)								ND			ND	ND	-	ND
The	Sb-125 (Approx. 3 years)								ND			ND	ND	-	ND
other y															
	Gross β	/	/	/					590			54	130	320	2,200,000
	H-3 (Approx. 12 years)	/	/	/	/	/	/	/	240,000	/	/	17,000	36,000	9,000	12,000
Sr	-90 (Approx. 29 years)	/	/	/	<u>/</u>	/	/	/	Under analysis	/	/	Under analysis	Under analysis	_	Under analysis
		Underground water observation hole No.1-17	Groundwater pumped up from the well point (between Unit 1 and 2)	Underground water observation hole No.2	Underground water observation hole No.2-2	Underground water observation hole No.2-3	Underground water observation hole No.2-5	Underground water observation hole No.2-6	Underground water observation hole No.2-7	Groundwater pumped up from the well point (between Unit 2 and 3)	Underground water observation hole No.3*	Underground water observation hole No.3-4	Underground water observation hole No.3-5		
	Date of sampling	Jan 09, 2014	/	1 /	/	1		/	/	1	/	/	/		
	Time of sampling	10:45 AM													
	Chloride (unit: ppm)	-													
C	s-134 (Approx. 2 years)	ND(0.54)													
Cs	s-137 (Approx.30 years)	ND(0.45)													
	Co-60 (Approx. 5 years)	0.37													
The	Sb-125 (Approx. 3 years)	1.8													
other y															
							<u> </u>								
	Gross β	89													
-	H-3 (Approx. 12 years)	30,000	/	1/	/	/	/	/	/	/	/	/			
			/	/	/	/	-	I	/	. /	/	/	-		
	-90 (Approx. 29 years)	Under analysis	/	/		/	/	/		/	/		/		

<sup>\*</sup> Data announced this time is provided in a thick-frame. The other data was announced on January 10.

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<sup>\* &</sup>quot;-" indicates that the measurement was out of range.

<sup>\*</sup> The results obtained in the observation hole No.3 are just for reference, since the water was highly turbid.

## Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (2/4) Underground Water Obtained at Bank Protection

Unit: Bq/L (exclude chloride) Underground water observation hole No.0-3-2 hole No.0-1 hole No.0-1-1 hole No.0-1-2 hole No.0-2 hole No.0-3-1 hole No.0-4 hole No.1 hole No.1-8 hole No.1-9 hole No.1-11 hole No.1-12 hole No.1-14 hole No.1-16 Jan 13, 2014 Date of sampling Time of sampling 9:20 AM 9:38 AM 10:02 AM 10:15 AM 10:30 AM 10:40 AM Chloride (unit: ppm) Cs-134 (Approx. 2 years) ND(0.45) 31 1.1 4.9 0.79 ND(2.8) Cs-137 (Approx.30 years) ND(0.45) 71 2.8 1.9 2.5 Mn-54 (Approx. 310 days) 7.0 ND ND ND ND ND ND 0.67 ND ND ND ND Co-60 (Approx. 5 years) The other y Ru-106 (Approx. 370 days) 3.7 ND 7.3 Sb-125 (Approx. 3 years) Gross B 360 2,400,000 Under analysis Under analysis H-3 (Approx. 12 years) Under analysis Under analysis Under analysis Under analysis

Under analysis

Under analysis


		Underground water observation hole No.1-17	Groundwater pumped up from the well point (between Unit 1 and 2)	Underground water observation hole No.2	Underground water observation hole No.2-2	Underground water observation hole No.2-3	Underground water observation hole No.2-5	Underground water observation hole No.2-6	Underground water observation hole No.2-7	Groundwater pumped up from the well point (between Unit 2 and 3)	Underground water observation hole No.3*	Underground water observation hole No.3-4	Underground water observation hole No.3-5
	Date of sampling	Jan 13, 2014	Jan 13, 2014		/	/	/		/	/	/	1	
	Time of sampling	9:40 AM	9:20 AM										
	Chloride (unit: ppm)	-	-										
	Cs-134 (Approx. 2 years)	ND(0.53)	7.2										
	Cs-137 (Approx.30 years)	ND(0.44)	17				/						
	Mn-54 (Approx. 310 days)	ND	0.72										
The	Co-60 (Approx. 5 years)	0.48	ND										
other y	Ru-106 (Approx. 370 days)	ND	7.0										
	Sb-125 (Approx. 3 years)	1.2	ND										
	Gross β	120	170,000										
	H-3 (Approx. 12 years)	Under analysis	Under analysis		1/				/	1/			
	Sr-90 (Approx. 29 years)	_	_	/	/	/	V		V	/	/		/

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

Sr-90 (Approx. 29 years)

<sup>\* &</sup>quot;-" indicates that the measurement was out of range

# Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Seawater)

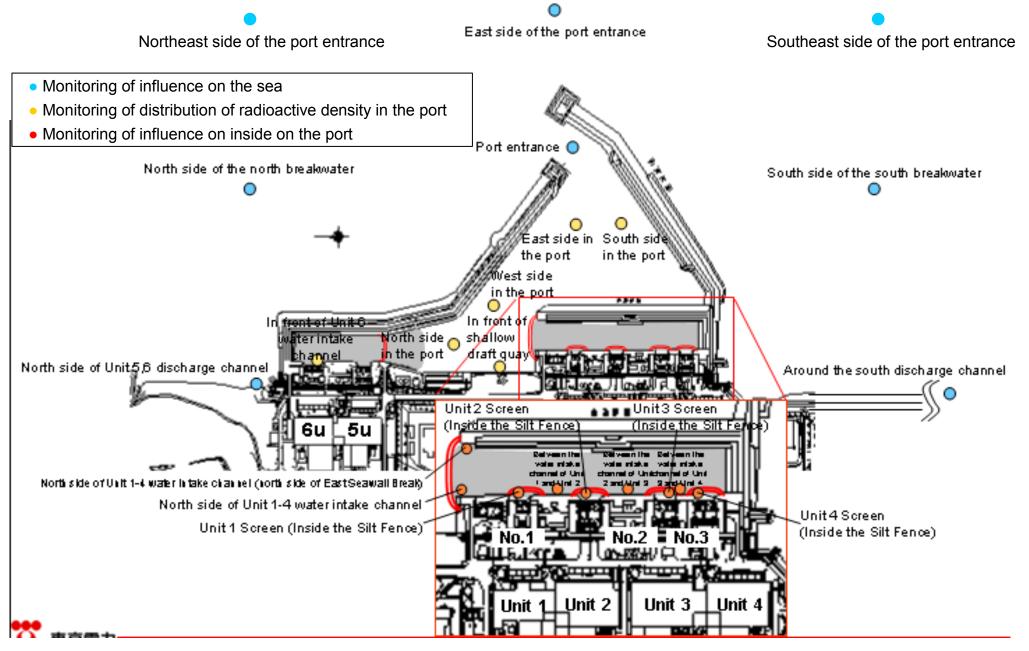

### Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (3/3)

Unit: Ba/l

	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 3 and Unit 4	Density Limit Specified by the Reactor Regulatio n *	WHO Guideline s for drinking- water quality
Date of Sampling	Jan 13, 2014	Jan 13, 2014	Jan 13, 2014	/	Jan 13, 2014	Jan 13, 2014	/	/	Jan 13, 2014	Jan 13, 2014	Jan 13, 2014	Jan 13, 2014		
Time of sampling	6:30 AM	6:40 AM	6:19 AM		6:53 AM	6:27 AM			6:31 AM	6:36 AM	6:41 AM	6:45 AM		
Cs-134(Approx. 2 years)	ND(0.81)	ND(3.0)	2.4		5.3	16			15	9.6	11	8.0	60	10
Cs-137(Approx.30 years)	ND(0.82)	3.7	5.8		16	40			35	30	28	19	90	10
Gross β	11	19	33		46	230			230	140	110	85		
H-3 (Approx. 12 years)	Under analysis	Under analysis	Under analysis		Under analysis	Under analysis			Under analysis	Under analysis	Under analysis	Under analysis	60,000	10,000
Sr-90 (Approx. 29 years)	Under analysis	-	Under analysis		Under analysis	Under analysis		/	Under analysis	Under analysis	Under analysis	Under analysis	30	10
														Unit: Bq/L
	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, Unit 1 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 1 and Unit 2 (surface layer)	1F, Between the water intake channel of Unit 1 and Unit 2 (lower layer)	1F, Unit 2 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 2 and Unit 3	1F, Unit 3 Screen (Inside the Silt Fence)	1F, Between the water intake channel of Unit 3 and Unit 4	Density Limit Specified by the Reactor Regulatio n *	WHO Guideline s for drinking- water quality
Date of Sampling	Jan 13, 2014	Jan 13, 2014		/							/			
Time of sampling	6:44 AM	5:50 AM												
Cs-134(Approx. 2 years)	0.0		/	/	/	/	/	/	/	/	/	/		
	8.6	ND(0.73)									/		60	10
Cs-137(Approx.30 years)	22	ND(0.73) ND(0.59)											90	10
Cs-137(Approx.30 years)  Gross β		` ′												
,	22	ND(0.59)												

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

<sup>\* &</sup>quot;-" indicates that the measurement was out of range.

<sup>\*</sup> Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/crto Bq/L]).

		Groun observa No	tion hole	Ground observati No.0	tion hole	Groun observa No.0	tion hole	observa	ndwater ation hole .0-2	observa	ndwater ation hole 0-3-1	observa	idwater ation hole 0-3-2	Ground observa No.	tion hole	Ground observat No	tion hole	Ground observat No.1	tion hole	Groun observa No.	tion hole	Ground observat No.:	ion hole	Groun observa No.	tion hole	Ground observat No.	tion hole
Cs-	134 (Approx. 2 years)	7.6	(12/15)	ND		ND		0.61	[10/13]	0.44	[11/24]	0.41	[12/26]	ND		13	[8/29]	1.9	[7/8]	11,000	(7/9)	10	(9/2)	1.5	[7/8]	310	(8/5)
Cs-	137 (Approx.30 years)	17	(12/15) (12/29)	0.58	[12/7]	0.51	[11/17]	2.2	<1/12>	0.86	[11/20]	0.91	[12/26]	1.4	<1/12>	31	[8/29]	3.6	(7/8)	22,000	[7/9]	24	(9/2)	3.6	[7/8]	650	(8/5)
	Ru-106 (Approx. 370 days)	ND		ND		ND		ND		ND		ND		ND		26	[5/24]	7.9	(7/8)	160	(8/15)	17	(7/22) (8/8)	3.1	(8/8)	ND	
The other	Mn-54 (Approx. 310 days)	ND		ND		ND		ND		ND		0.40	<1/5>	ND		ND		1.0	(7/5)	62	(7/5)	ND		ND		ND	
Y	Co-60 (Approx. 5 years)	ND		ND		ND		ND		ND		ND		ND		0.50	[7/19]	ND		3.1	(7/8)	ND		ND		ND	
	Sb-125 (Approx. 3 years)	ND		ND		ND		ND		ND		ND		ND		1.7	[7/11]	ND		250	(7/15)	1.4	(7/12) (8/26)	ND		12	(8/8)
	Gross β	300	(8/22)	21	[12/7]	21	[11/10]	87	[10/13]	ND		67°2	[12/11]	29	[12/29]	1,900	[5/24]	4,400	(7/8)	900,000	(7/5) (7/9)	160,000	(8/12) (8/15)	380	[8/19]	56,000	(8/5)
H-	-3 (Approx. 12 years)	45,000	(8/29)	18,000	[12/7]	74,000	(12/15)	3,900	<1/5>	ND		70,000	[12/29]	36,000	<1/5>	500,000	(5/24) (6/7)	630,000	[7/8]	430,000	(9/16)	290,000	(7/12)	98,000	(7/11)	72,000	(8/15)
Sr-	90(Approx. 29 years)	Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		1,200	(6/7)	Under analysis		Under analysis		Under analysis		Under analysis		Under analysis	

Unit: Bq/L

		observa	idwater ation hole .1-8		dwater tion hole .1-9		dwater tion hole 1-11	observa	dwater tion hole 1-12		dwater tion hole 1-14	Ground observat No.1	ion hole	Ground observa No.	tion hole	up from the	ter pumped e well point Init 1 and 2)
Cs	-134 (Approx. 2 years)	47	[11/25]	170	(9/3)	0.94	[10/31]	74	[10/21]	1.2	[11/14]	3.1"2	[12/13]	1.2	[12/5]	110	(9/23)
Cs-	137 (Approx.30 years)	110	(11/25)	380	(9/3)	2.2	[12/2]	170	[10/21]	2.3	[11/21]	3.4	[10/10]	0.66	[12/12]	250	(9/23)
	Ru-106 (Approx. 370 days)	ND		ND		ND		5.4	[10/28]	ND		9.2	[10/28]	4.1	[12/12]	25	(9/2)
The other	Mn-54 (Approx. 310 days)	9.7	(12/16)	ND		ND		ND		ND		ND		ND		0.83	[12/30]
Y	Co-60 (Approx. 5 years)	0.63	[12/23]	ND		ND		0.51	[10/24]	ND		0.9	[11/7]	0.61	[11/25]	ND	
	Sb-125 (Approx. 3 years)	ND		ND		ND		61	[10/21]	ND		11	[12/5]	2.1	[11/25]	ND	
	Gross β	39,000	<1/6>	2,100	(11/17)	2,300	[12/26]	730	[10/21]	320	<1/9>	2,200,000	<1/9>	130	(12/2) (12/23)	700,000	(9/23)
н	-3 (Approx. 12 years)	12,000	<1/6>	860	(11/14)	85,000	(9/13)	440,000	[10/31]	11,000	[11/25]	43,000	(9/26)	26,000	<1/6>	460,000	(8/19)
Sr-	90(Approx. 29 years)	Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		0	

Unit: Bq/L

																									UIIIL BY/L
		observa	ndwater ation hole o.2	observa	dwater ition hole 2-1*	observ	ndwater ation hole 0.2-2	observa	ndwater ation hole i.2-3	Groun observa No.2	tion hole	observa	ndwater ation hole i.2-6	observa	dwater ation hole .2-7	up from t	ater pumped he well point Unit 2 and 3)	observa	ndwater ation hole o.3	observa	dwater tion hole 3-1*	observa	ndwater ation hole .3-4	observ	ndwater ation hole 0.3-5
Cs	-134 (Approx. 2 years)	0.50	(7/9)	0.66	[9/1]	12	<1/12>	0.84	<1/5>	13	<1/8>	0.56	(10/30)	1.5	<1/12>	1.1	[12/12]	3.5	(7/25)	1.2	(7/25) (8/8)	1.9	<1/8>	29	[12/18]
Cs	-137 (Approx.30 years)	1.2	(7/11) (8/1)	1.1	(8/29) (9/1)	28	<1/1> <1/12>	2.6	<1/5>	30	<1/8>	0.61	[10/13]	3.6	<1/12>	2.4	(12/7)	5.9	(8/8)	2.6	(8/1)	4.3	[11/27]	74	(12/18)
	Ru-106 (Approx. 370 days)	ND		ND		ND		ND		ND		ND		ND		ND		ND		ND		ND			
The other	Mn-54 (Approx. 310 days)	ND		ND		ND		0.29	[12/6]	0.94	<1/8>	ND		ND		ND		ND		ND		0.54	[10/30]		
Υ	Co-60 (Approx. 5 years)	ND		ND		ND		ND		ND		ND		ND		ND		ND		ND		ND			
	Sb-125 (Approx. 3 years)	ND		ND		ND		ND		26	(9/29)	ND		ND		ND		1.6	<1/1>	ND		ND			
	Gross β	1,700	(7/8)	380	(7/29)	530	[12/29]	1,500	[12/6]	46,000	(9/29)	3,200	[12/5]	270	[12/20]	240,000	[12/12]	1,400	(7/11)	180	(8/1)	ND		43	[12/18]
н	-3 (Approx. 12 years)	870	[12/8]	440	(8/26)	660	<1/8>	1,700	[12/6]	6,300	[12/4]	1,200	(11/24) (11/27)	1,000	(11/21) (12/4)	5,100	[12/6]	3,200	(H24. 12/12)	460	(8/1)	170	(9/18)	170	<1/8>
Si	-90(Approx. 29 years)	54	(5/31)	Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		-		8.3	(H24. 12/12)	Under analysis		Under analysis		-	

<sup>\*1</sup> The analysis result of No.2-5 obtained on September 29 is the reference value, since we could not sample groundwater by a regular procedure.

<sup>\*2</sup> Analysis result of pumped water.

<sup>\*3</sup> The results obtained in the observation hole No.1-14 on January 9 are just for reference, since the water was highly turbid.

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit.

 $<sup>^{\</sup>star}$  Date of sampling is provided in parentheses;[mm/dd] for FY2013 and <mm/dd> for FY2014.

<sup>\* \*\*\*</sup> is provided next to the name of the holes where the sampling could not be performed due to the chemical injection of ground improvement.

#### <Reference> The Highest Dose Until the Previous Measurement\* (Seawater)

Unit: Bq/L

		side of Unit arge channel		nt of Unit 6 ake channel		t of shallow quay	1-4 wat	side of Unit er intake innel	1-4 wat channel (n	side of Unit er intake orth side of wall Break)	,	1 Screen Silt Fence)	intake cha 1 and Uni	en the water innel of Unit t 2 (surface yer)	intake cha 1 and Un			2 Screen Silt Fence)	intake char	en the water nnel of Unit Unit 3	1F, Unit : (Inside the	3 Screen	intake char	n the water nnel of Unit Unit 4
Cs-134(Approx. 2 years)	1.8	[6/21]	2.8	[12/2]	5.3	[8/5]	89	[10/10]	32	[10/11]	73	[10/10]	87	[10/10]	93	[10/10]	370	[10/9]	52	[12/21]	350	[7/15]	28	[9/16]
Cs-137(Approx.30 years)	3.3	[6/26]	5.8	[12/2]	8.6	[8/5]	190	[10/10]	73	[10/11]	170	[10/10]	200	[10/10]	200	[10/10]	830	[10/9]	110	[10/11] [12/21]	770	[7/15]	53	[12/16]
Gross β	17	<1/6>	46	[8/19]	40	[7/3]	1,400	[11/7]	320	[8/12]	740	[10/28]	1,200	[12/8]	450	[7/16]	1,700	[10/9]	480	[10/7]	1,000	[7/15]	390	[8/12]
H-3 (Approx. 12 years)	8.6	[6/26]	24	[8/19]	340	[6/26]	4,800	[11/7]	510	[9/2]	2,800	[10/28]	2,800	[12/8]	1,600	[9/1]	2,100	[10/28]	1,200	[10/7]	410	[9/2]	650	[8/12]
Sr-90 (Approx. 29 years)	5.8	[6/26]	-		7.4	[6/26]	Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis		Under analysis	

Unit: Bq/L

	1F, Unit (Inside the	4 Screen Silt Fence)		d the south e channel	1F, Port	t entrance	1F, East s	side in the ort		side in the ort		side in the ort		n side in the port		of the north water	Northeast side of the port entrance	East side of the so breakwater	th Southeast side of the north breakwater	South side of the south breakwater
Cs-134(Approx. 2 years)	62	[9/16]	ND		3.3	[12/24]	3.3	[10/17]	4.4	[12/24]	5.0	[12/2]	3.5	[10/17]	ND		ND	ND	ND	ND
Cs-137(Approx.30 years)	140	[9/16]	3.0	[7/15]	7.3	[10/11]	9.0	[10/17]	10	[12/24]	8.4	[12/2]	7.8	[10/17]	ND		ND	1.6 [10/1	) ND	ND
Gross β	360	[10/7]	13	(12/16) (12/30)	69	[8/19]	74	[8/19]	60	[7/4]	69	[8/19]	79	[8/19]	ND		ND	ND	ND	ND
H-3 (Approx. 12 years)	400	[8/12] [10/7]	1.9	[11/25]	68	[8/19]	67	[8/19]	59	[8/19]	52	[8/19]	60	[8/19]	4.7	[8/14]	ND	6.4 (10/8	) ND	ND
Sr-90 (Approx. 29 years)	Under analysis		0.36	[6/26]	3.5	[6/20]	Under analysis		Under analysis		-		1		-		-	_	-	-

<sup>\*</sup> The highest result announced in "Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection" or the other handouts is provided.

As for "1F, North side of Unit 1-4 water intake channel", the data is obtained since January 14, 2013. For the other locations, the data is obtained since June 14.

[Reference] Standard values				Unit: Bq/L
	Cs-134	Cs-137	H-3	Sr-90
Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)	60	90	60,000	30
WHO Guidelines for drinking-water quality	10	10	10,000	10

<sup>\* &</sup>quot;ND" indicates that the measurement result is below the detection limit.

<sup>\*</sup> Date of sampling is provided in parentheses; [mm/dd] for FY2013 and <mm/dd> for FY2014.

<sup>\* &</sup>quot;-" indicates that the measurement was out of range.