
Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Underground Water Obtained at Bank Protection)

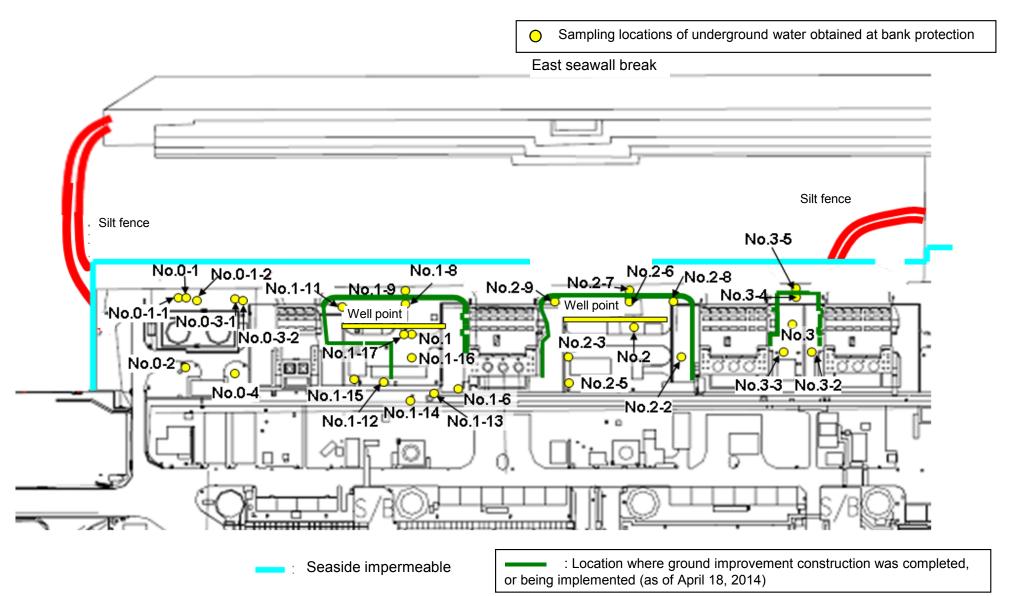

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (1/3) Underground Water Obtained at Bank Protection

															Unit: Bq/	L (exclude chloride)
		Underground water observation hole No.0-1*	Underground water observation hole No.0-1-2	Underground water observation hole No.0-2	Underground water observation hole No.0-3-1	Underground water observation hole No.0-3-2	Underground water observation hole No.0-4	Underground water observation hole No.1	Underground water observation hole No.1-6	Underground water observation hole No.1-8	Underground water observation hole No.1-9 (note)	Underground water observation hole No.1-11	Underground water observation hole No.1-12	Underground water observation hole No.1-14*	Underground water observation hole No.1-16	Underground water observation hole No.1-17
	Date of sampling	December 21, 2014	December 21, 2014	December 21, 2014	December 21, 2014	December 22, 2014	December 21, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 23, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014
	Time of sampling	10:40 AM	9:53 AM	9:20 AM	9:38 AM	9:30 AM	8:46 AM	9:13 AM	10:15 AM	9:57 AM	7:25 AM	9:35 AM	9:38 AM	9:42 AM	10:01 AM	10:20 AM
	Chloride (unit: ppm)	-	-	-	-	-	-	-	-	-	20	-	-	-	-	-
C	s-134 (Approx. 2 years)	-	ND(0.41)	ND(0.34)	ND(0.37)	ND(0.45)	ND(0.36)	ND(0.42)	12,000	18	-	ND(0.39)	2.0	91	ND(1.9)	ND(0.40)
Cs	s-137 (Approx.30 years)	-	ND(0.57)	ND(0.42)	ND(0.54)	ND(0.52)	ND(0.52)	ND(0.53)	38,000	55	-	1.1	6.6	320	1.7	ND(0.52)
	Mn-54 (Approx. 310 days)	-	ND	ND	ND	ND	ND	ND	ND	ND	-	ND	ND	ND	ND	ND
The	Co-60 (Approx. 5 years)	-	ND	ND	ND	ND	ND	ND	260	ND	-	ND	ND	ND	ND	ND
other y	Sb-125 (Approx. 3 years)	-	ND	ND	ND	ND	ND	ND	ND	ND	-	ND	ND	ND	5.2	ND
	Gross β	190	ND(19)	19	ND(19)	53	ND(19)	75	480,000	26,000	ND(21)	22	160	19,000	470,000	64,000
ł	I-3 (Approx. 12 years)	1,500	10,000	370	ND(110)	14,000	25,000	170,000	6,600	31,000	ND(100)	10,000	29,000	11,000	1,900	28,000
Sr	-90 (Approx. 29 years)	-	-	-	-	-	-	-	-	-	-	-	-	-	-	-

		Groundwater pumped up from the well point (between Unit 1 and 2)	Underground water observation hole No.2	Underground water observation hole No.2-2	Underground water observation hole No.2-3	Underground water observation hole No.2-5 (note)	Underground water observation hole No.2-6	Underground water observation hole No.2-7	Underground water observation hole No.2-8	Groundwater pumped up from the well point (between Unit 2 and 3)	Underground water observation hole No.3*	Underground water observation hole No.3-2	Underground water observation hole No.3-3	Underground water observation hole No.3-4	Underground water observation hole No.3-5(note)
	Date of sampling	December 22, 2014	/	/	/ /	/	December 23, 2014	/	/ /		/ /	/	/ /	/ /	/
	Time of sampling	10:00 AM		/		/	8:38 AM	/		/		/			/
	Chloride (unit: ppm)	-				/	-								
C	Cs-134 (Approx. 2 years)	22				/	ND(0.36)								
C	Cs-137 (Approx.30 years)	75				/	ND(0.51)	/							
	Mn-54 (Approx. 310 days)	23				/	ND	/							/
The	Co-60 (Approx. 5 years)	ND				/	ND	/							
other y	Sb-125 (Approx. 3 years)	ND					ND								
	Gross β	1,100,000					520								
	H-3 (Approx. 12 years)	90,000	1/	/	/	/	790	/				/	/		/
s	Sr-90 (Approx. 29 years)	-	/	/	/	/	-	/		/	/	/		/	

* Data announced this time is provided in a thick-frame. The other data was announced on December 22, 23, and 24, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other y".

* "-" indicates that the measurement was out of range.

(Note) As for No. 1-9, 2-5, and 3-5, γ was not measured because they are samlpled by sampler. Gross β were measured after filtation for references.

 $^*\!\gamma$ was not measured because the water was highly turbid. (Gross β were measured after filtration as references.)

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (2/3) Underground Water Obtained at Bank Protection

														Unit: Bq/	L (exclude chloride)
	Underground water observation hole No.0-1	Underground water observation hole No.0-1-2	Underground water observation hole No.0-2	Underground water observation hole No.0-3-1	Underground water observation hole No.0-3-2	Underground water observation hole No.0-4	Underground water observation hole No.1	Underground water observation hole No.1-6	Underground water observation hole No.1-8	Underground water observation hole No.1-9 (note)	Underground water observation hole No.1-11	Underground water observation hole No.1-12	Underground water observation hole No.1-14	Underground water observation hole No.1-16	Underground water observation hole No.1-17
Date of sampling		/ /	/		December 25, 2014	/	December 25, 2014	December 25, 2014		December 25, 2014	December 25, 2014	December 25, 2014	December 25, 2014	December 25, 2014	December 25, 2014
Time of sampling	/			/	9:30	/	9:31	10:13	/	7:57	9:57	9:31	9:36	9:53	10:15
Chloride (unit: ppm)					-	/	-	-		20	-	-	-	-	-
Cs-134 (Approx. 2 years)					ND(0.44)		ND(0.38)	12,000		-	0.36	2.4	57	ND(1.0)	ND(0.51)
Cs-137 (Approx.30 years)					ND(0.53)	/	0.73	39,000		-	0.70	5.1	180	1.3	ND(0.59)
Co-60 (Approx. 5 years)					ND	/	ND	310	/	-	ND	ND	ND	ND	ND
The Ru-106 (Approx. 370 days)					ND		3.2	ND		-	ND	ND	ND	ND	ND
other y Sb-125 (Approx. 3 years)					ND		ND	ND		-	ND	ND	ND	3.9	ND
Gross β					61		82	490,000		ND(18)	36	190	19,000	470,000	92,000
H-3 (Approx. 12 years)		1/	/	/	Under analysis	/	Under analysis	Under analysis	/	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis	Under analysis
Sr-90 (Approx. 29 years)	/	/	/	/	-	/	-	-	/	-	-	-	-	-	-


			Groundwater pumped up from the well point (between Unit 1 and 2)	Underground water observation hole No.2	Underground water observation hole No.2-2	Underground water observation hole No.2-3	Underground water observation hole No.2-5 (note)		Underground water observation hole No.2-7		Groundwater pumped up from the well point (between Unit 2 and 3)	Underground water observation hole No.3	Underground water observation hole No.3-2	Underground water observation hole No.3-3	Underground water observation hole No.3-4	Underground water observation hole No.3-5(note)
	Date of samp	ling	/	/	1 /	/	/	December 25, 2014		/ /	/	/ /	/ /	/	/	/
	Time of samp	oling	/	/	/	/		8:48 AM	/		/	/		/	/	
	Chloride (unit:	ppm)	/					-	/			/		/	/	
	Cs-134 (Approx.	2 years)						ND(0.32)	/							
	Cs-137 (Approx.3	0 years)	/					ND(0.42)								
	Co-60 (Appr	ox. 5 years)			/			ND								
The	Ru-106 (Appr	ox. 370 days)						ND								
othe	Sb-125 (App	rox. 3 years)						ND								
	Gross β							490	/							
	H-3 (Approx. 12	years)	/	/		/	/	Under analysis	/		/	/	/	/		/
	Sr-90 (Approx. 29	9 years)	/	/	/	/	/	-	/		/	/	/	/	/	

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses, except "the other y".

* "-" indicates that the measurement was out of range.

(Note) As for No. 1-9, 2-5, and 3-5, γ was not measured because they are samlpled by sampler. Gross β were measured after filtation for references.

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (Sampling Locations of Seawater)

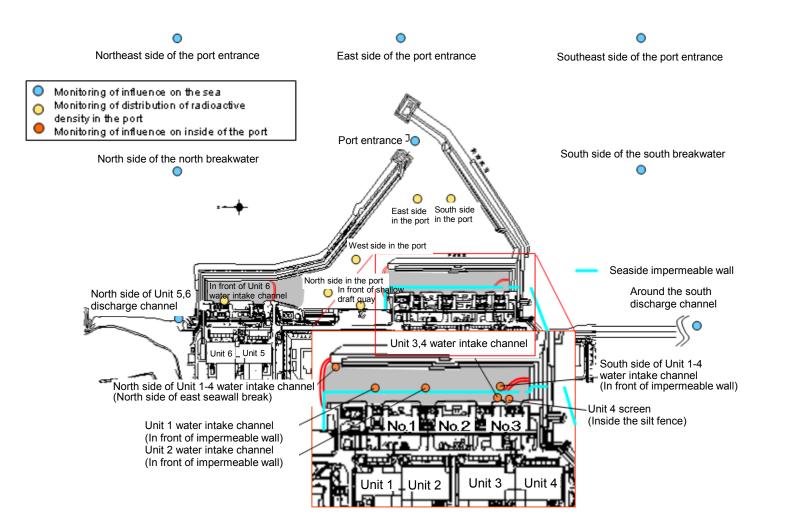

												Unit: Bq/L
	1F, North side of Unit 5,6 discharge channel	1F, In front of Unit 6 water intake channel	1F, In front of shallow draft quay	1F, North side of Unit 1-4 water intake channel (north side of East Seawall Break)	1F, In front of Unit 1 water intake channel (in front of impermeable wall)	1F, In front of Unit 2 water intake channel (in front of impermeable wall)	1F, In front of Unit 3 & 4 water intake channel	1F, Unit 4 Screen	1F, South side of Unit 1-4 water intake channel (in front of impermeable wall)	1F, Around the south discharge channel	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking- water quality
Date of Sampling	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014	December 22, 2014		
Time of sampling	6:30 AM	7:00 AM	6:48 AM	7:14 AM	6:55 AM	6:58 AM	7:06 AM	7:03 AM	7:09 AM	5:50 AM		
Cs-134(Approx. 2 years)	ND(0.55)	ND(2.8)	ND(1.6)	3.9	3.2	4.8	5.5	5.5	2.6	ND(0.58)	60	10
Cs-137(Approx.30 years)	ND(0.72)	ND(2.1)	ND(1.8)	16	13	16	17	18	15	ND(0.58)	90	10
Gross β	14	ND(17)	ND(17)	85	80	85	110	99	81	12		
H-3 (Approx. 12 years)	1.6	7.5	3.7	150	150	190	220	190	180	ND(1.5)	60,000	10,000
Sr-90 (Approx. 29 years)	-	_	-	-	-	_	-	—	-	-	30	10

Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection (3/3) Seawater

												Unit: Bq/L
	1F, Port entrance	1F, East side in the port	1F, West side in the port	1F, North side in the port	1F, South side in the port	1F, North side of the north breakwater	1F, Port entrance (north-east side)	1F, Port entrance (east side)	1F, Port entrance (south-east side)	1F, South side of the south breakwater	Density Limit Specified by the Reactor Regulation *	WHO Guidelines for drinking- water quality
Date of Sampling	/	/	/	/	/	/	/		/	/		
Time of sampling												
Cs-134(Approx. 2 years)						/	/	/			60	10
Cs-137(Approx.30 years)											90	10
Gross β												
H-3 (Approx. 12 years)											60,000	10,000
Sr-90 (Approx. 29 years)	/	/	/	/	/	/	/	/		/	30	10

* Data announced this time is provided in a thick-frame. The other data was announced on December 23, 2014.

* "ND" indicates that the measurement result is below the detection limit, and the detection limit of each nuclide is provided in parentheses.

* "-" indicates that the measurement was out of range.

* Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2 [the amount is converted from Bq/cm³ to Bq/L]).

<Reference> The Highest Dose Until the Previous Measurement (Groundwater Obtained at Bank Protection)

		-														,													Unit: Bo
		observ	ndwater ation hole 0.0-1	observ	ndwater ation hole .0-1-1		dwater tion hole)-1-2	observa	idwater ition hole .0-2	observa	ndwater ation hole .0-3-1	observa	idwater ition hole 0-3-2	observa	ndwater ation hole 0.0-4	observa	dwater tion hole p.1	observa	idwater ition hole .1-1 [°]	observa	dwater tion hole 1-2 [*]	observa	idwater ition hole .1-3 [°]	observa	ndwater ation hole 0.1-4 [*]		dwater tion hole 1-5 [°]	Groun observa No.	
C	cs-134 (Approx. 2 years)	29	<5/25>	ND		0.61	<3/2>	0.61	[10/13]	0.64	<4/6>	1.3	<9/25>	0.70	<6/29>	13	[8/29]	1.9	[7/8]	11,000	[7/9]	10	[9/2]	1.5	[7/8]	310	[8/5]	67,000	<10/17
С	s-137 (Approx.30 years)	78	<5/25>	ND		1.5	<3/2>	2.2	<1/12>	1.1	<4/6>	5.1	<9/25>	1.6	<6/29>	31	[8/29]	3.6	[7/8]	22,000	[7/9]	24	[9/2]	3.6	[7/8]	650	[8/5]	200,000	<10/16
	Ru-106 (Approx. 370 days)	ND		ND		ND		ND		ND		ND		ND		26	[5/24]	7.9	[7/8]	160	[8/15]	17	[7/22] [8/8]	3.1	[8/8]	ND		ND	
The	Mn-54 (Approx. 310 days)	ND		ND		ND		ND		ND		0.64	<2/20>	ND		ND		1.0	[7/5]	62	[7/5]	ND		ND		ND		700	<10/13
other y	Co-60 (Approx. 5 years)	ND		ND		ND		ND		ND		ND		ND		0.50	[7/19]	ND		3.1	[7/8]	ND		ND		ND		3,600	<10/13
	Sb-125 (Approx. 3 years)	ND		ND		ND		ND		ND		ND		ND		1.7	[7/11]	ND		250	[7/15]	1.4	[7/12] [8/26]	ND		12	[8/8]	34	<5/19>
	Gross β	300	[8/29] <5/18>	21	[12/7]	24	<6/22>	87	[10/13]	ND		74	<10/9>	44	<6/22>	1,900	[5/24]	4,400	[7/8]	9,300,000	[7/8]	160,000	[8/12] [8/15]	380	[8/19]	56,000	[8/5]	7,800,000	<10/13
	H-3 (Approx. 12 years)	45,000	[8/29]	18,000	[12/7]	74,000	[12/15] <1/19>	6,800	<2/16>	ND		76,000	<2/6>	56,000	<2/23>	500,000	[5/24] [6/7]	630,000	[7/8]	430,000	[9/16]	290,000	[7/12]	98,000	[7/11]	72,000	[8/15]	110,000 * 2	<2/6>
ŝ	Sr-90(Approx. 29 years)	140	[8/8]	7.9	[12/7]	2.6	[11/10]	0.73	[9/2]	1.5	[11/20]	2.3	[12/6]	ND(0.83)	[10/27]	1,300	[8/22]	2,300	[6/28]	5,000,000	[7/5]	130,000	[8/8]	200	[7/8]	5,100	[8/22]	1,100,000	<8/4><10/2>
																													Unit: B
		observ	ndwater ation hole p.1-8	observ	ndwater ation hole o.1-9	Ground observat No.4	tion hole	observa	ndwater Ition hole 1-11	observa	ndwater ation hole .1-12	observa	ndwater Ition hole 1-13	observa	ndwater ation hole .1-14	observa	dwater tion hole 1-15	observa	ndwater Ition hole 1-16	observa	dwater tion hole 1-17	pumped the we (betwee	idwater d up from ell point en Unit 1 d 2)	observa	ndwater ation hole lo.2		dwater tion hole 2-1 [°]	observa	dwater tion hole .2-2
C	cs-134 (Approx. 2 years)	47	[11/25]	170	[9/3]	-		1.1	<1/13>	74	[10/21]	37,000	<2/13>	130	<10/18> <12/11>	ND		30	<7/28>	1.4	<7/7>	920	<11/13>	0.88	<2/26>	0.66	[9/1]	15	<2/12
С	s-137 (Approx.30 years)	110	[11/25]	380	[9/3]	-		3.4	<4/28>	170	[10/21]	93,000	<2/13>	430	<12/11>	0.88	<7/10>	86	<7/28>	3.0	<9/29>	3,000	<11/13>	2.5	<2/26>	1.1	[8/29] [9/1]	38	<2/12
	Ru-106 (Approx. 370 days)	ND		ND		-		ND		5.4	[10/28]	ND		ND		ND		9.2	[10/28]	5.5	<4/21> <5/1>	25	[9/2]	ND		ND		ND	
The	Mn-54 (Approx. 310 days)	12	<2/3>	ND		-		ND		ND		ND		3.8	<12/1>	ND		11	<8/25>	ND		110	<11/13>	ND		ND		ND	
other y	Co-60 (Approx. 5 years)	1.3	<2/3>	ND		-		ND		0.51	[10/24]	ND		0.44	<5/29>	ND		0.9	[11/7]	0.61	[11/25]	3.0	<11/24>	ND		ND		ND	
	Sb-125 (Approx. 3 years)	ND		ND		-		ND		61	[10/21]	ND		ND		ND		24	<6/16>	2.1	[11/25]	ND		ND		ND		ND	
	Gross β	59,000	<2/3>	2,100	2 [11/17]	78 ^{* 2}	<1/27>	2,300	[12/26]	1,100	<5/5>	260,000	<2/12> <2/13>	31,000	<11/20> <11/24> <12/1>	110	<7/10>	3,100,000	<1/20> <1/30> <2/3>	1,200,000	<10/9>	3,200,000	<11/13>	1,700	[7/8]	380	[7/29]	600	<4/16>
	H-3 (Approx. 12 years)	71,000	<12/1>	* 2 860	[11/14]	* 2 270,000	<1/27>	85,000	[9/13]	440,000	[10/31]	88,000	<2/12>	23,000	<2/13>	74,000	<7/10>	43,000	[9/26]	160,000	<10/13> <10/16> <11/3>	460,000	[8/19]	1,000	<2/23>	440	[8/26]	660	<1/8>
5	Sr-90(Approx. 29 years)	35,000	<2/17>	300	[10/3]	-		170	<8/4>	290	[10/21]	160,000	<2/12>	28,000	<10/2>	Under analysis		2,700,000	<2/13>	990,000	<10/2>	-		54	[5/31]	5.9	[7/25]	320	[12/25
														-				-				-					Unit: Bq/L		
		observ	ndwater ation hole p.2-3	observ	ndwater ation hole o.2-5		dwater tion hole 2-6	observa	idwater ition hole .2-7	observa	ndwater ation hole 5.2-8	observa	ndwater Ition hole I.2-9	pumped the we (betwee	ndwater d up from ell point en Unit 2 id 3)	observa	dwater tion hole 5.3	observa	ndwater ation hole .3-1	observa	dwater tion hole .3-2	observa	ndwater Ition hole I.3-3	observa	ndwater ation hole 5.3-4	observa	dwater tion hole .3-5		
																-													

		No	0.2-3	No	.2-5	No	.2-6	No	.2-7	No	0.2-8	No.	2-9		n Unit 2 d 3)	N	lo.3	No	.3-1	No	.3-2	No	.3-3	No	0.3-4	No	0.3-5
(Cs-134 (Approx. 2 years)	2.2	<2/26>	41	<5/7>	17	<3/11>	3.5	<2/23>	1.3	<7/20>	ND		2.2	<9/7>	3.5	[7/25]	1.2	[7/25] [8/8]	23	<8/27>	180	<7/2>	5.1	<7/23>	100	<7/30>
C	s-137 (Approx.30 years)	5.5	<2/26>	110	<5/7>	50	<3/11>	9.0	<2/23>	3.4	<7/20>	0.58 ^{* 2}	<2/11>	5.7	<9/7>	5.9	[8/8]	2.6	[8/1]	68	<9/3>	500	<7/2>	16	<8/27>	310	<7/30>
	Ru-106 (Approx. 370 days)	ND		ND		ND		ND		ND		6.5 ^{* 2}	<2/11>	ND		ND		ND		ND		ND		ND		-	
The	Mn-54 (Approx. 310 days)	0.29	[12/6]	0.95	<6/4>	ND		ND		ND		ND		ND		ND		ND		ND		ND		0.54	[10/30]	I	
other	Co-60 (Approx. 5 years)	ND		ND		ND		ND		ND		ND		ND		ND		ND		ND		ND		ND		I	
	Sb-125 (Approx. 3 years)	ND		74	<5/7>	ND		ND		ND		ND		ND		1.6	<1/1>	ND		ND		ND		ND		-	
	Gross β	1,500	[12/6] <1/8>	150,000	<2/12>	3,200	[12/5] <11/6>	1,300	<6/20>	5,800	<7/23>	1,700	<2/7>	240,000	[12/12]	1,400	[7/11]	180	[8/1]	3,100	<8/20> <8/28>	8,900	<7/2>	46	<8/13>	510	<7/16>
	H-3 (Approx. 12 years)	1,700	[12/6]	7,900	<4/9>	1,900	<8/10>	1,100	<1/19>	1,700	<4/6> <8/6> <8/13>	* 2 13,000	<2/7> <2/11>	13,000	<10/19> <10/26> <10/29>	3,200	[2012. 12/12]	460	[8/1]	3,700	<7/9>	8,000	<5/7>	170	[9/18]	170	<1/8>
	Sr-90(Approx. 29 years)	1,200	[12/6]	34,000	<5/7>	Under analysis		ND(1.4)	[11/21]	3,900	<3/30>	1,200 ^{* 2}	<2/11>	-		8.3	[2012. 12/12]	4.4	[7/23]	2000	<4/18>	3,600	<4/30>	ND		200	<5/28>

• Since some samples are still under analysis, the highest dose of the Strontium-90 is among those previously announced.

*1 Analysis result of pumped water.

*2 The results are for reference, since the water was highly turbid. (γ and Gross β were measured after filtration.)

* "ND" indicates that the measurement result is below the detection limit.

* Table of sampling is provided in parentheses. []: 2013, <>: 2014 * "*" is provided next to the name of the holes where the sampling could not be performed due to the chemical injection of ground improvement.

(Note) As for No. 1-9, 2-5, and 3-5, since September 17, γ was not measured because they are samlpled by sampler. Gross β were measured after filtation for reference.

<Reference> The Highest Dose Until the Previous Measurement* (Seawater)

													-							Unit: Bq/L
		side of Unit arge channel		ont of Unit 6 ake channel	,	t of shallow quay	4 water in (north s	side of Unit 1- itake channel iide of East all Break)	water inta (in front of	nt of Unit 1 ake channel impermeable vall)	water inta (in front of	nt of Unit 2 ake channel impermeable vall)	intake chan	en the water nel of Unit 3 Unit 4		t 4 screen e silt fense)	4 water in (in front of	side of Unit 1- take channel impermeable vall)		und sounth ge channel
Cs-134(Approx. 2 years)	1.8	[6/21]	2.8	[12/2]	5.3	[8/5]	32	[10/11]	12	<6/23>	12	<9/8>	50	<9/22>	62	[9/16]	24	<11/3>	1.8	<6/9>
Cs-137(Approx.30 years)	4.5	<3/17>	5.8	[12/2]	8.6	[8/5]	73	[10/11]	33	<5/12>	40	<9/8>	150	<9/22>	140	[9/16] <9/22>	64	<11/3>	4.9	<6/9>
Gross β	17	<1/6>	46	[8/19]	40	[7/3]	320	[8/12]	170	<12/8>	170	<11/24>	660	<6/9>	680	<9/22>	380	<3/10>	16	<6/9> <8/4>
H-3 (Approx. 12 years)	8.7	<5/12>	24	[8/19]	340	[6/26]	600	[8/18]	460	<8/18>	350	<8/18>	2,500	<6/23>	2,200	<7/21>	810	<8/4> <11/3>	5.6	<5/19>
Sr-90 (Approx. 29 years)	4.7	[6/26]			7.2	[6/26]	220	[8/19]	-				660	<6/9>	470	<8/4>	_		0.29	[6/26]

		East side he port		Vest side he port		orth side ne port		outh side ne port	1F, Cent	er in the port		orth side h breakwater		theast side ort entrance		ast side rt entrance		east side rt entrance		Unit: Bq/L outh side th breakwater
Cs-134(Approx. 2 years)	3.3	[12/24]	3.3	[10/17]	4.4	[12/24]	5.0	[12/2]	3.5	[10/17]	ND		ND		ND		ND		ND	
Cs-137(Approx.30 years)	7.3	[10/11]	9.0	[10/17]	10.0	[12/24]	8.4	[12/2]	7.8	[10/17]	ND		0.7	<10/8>	1.6	[10/18]	ND		ND	
Gross β	69	[8/19]	74	[8/19]	60	[7/4]	69	[8/19]	79	[8/19]	ND		ND		ND		ND		ND	
H-3 (Approx. 12 years)	68	[8/19]	67	[8/19]	59	[8/19]	52	[8/19]	60	[8/19]	4.7	[8/14]	1.8	<10/1> <12/15>	6.4	[10/8]	1.8	<5/29>	2.8	<4/23>
Sr-90 (Approx. 29 years)	49	[8/19]	-		-		_		-		-		_		-		-		-	

* The highest result announced in "Detailed Analysis Results in the Port of Fukushima Daiichi NPS, around Discharge Channel and Bank Protection" or the other handouts is provided.

As for "1F, North side of Unit 1-4 water intake channel", the data is obtained since January 14, 2013. For the other locations, the data is obtained since June 14.

• Since some samples are still under analysis, the highest dose of the Strontium-90 is among those previously announced.

* "ND" indicates that the measurement result is below the detection limit.

* Date of sampling is provided in parentheses. []: 2013, < >: 2014

* "-" indicates that the measurement was out of range.

[Reference] Standard values

	Cs-134	Cs-137	H-3	Sr-90
Density Limit Specified by the Rule for the Installation, Operation, etc. of Commercial Nuclear Power Reactors (the density limit in the water outside the surrounding monitored areas is provided in section 6 of Appendix 2)	60	90	60,000	30
WHO Guidelines for drinking-water quality	10	10	10,000	10