
<Reference> May 29, 2013
Tokvo Electric Power Company

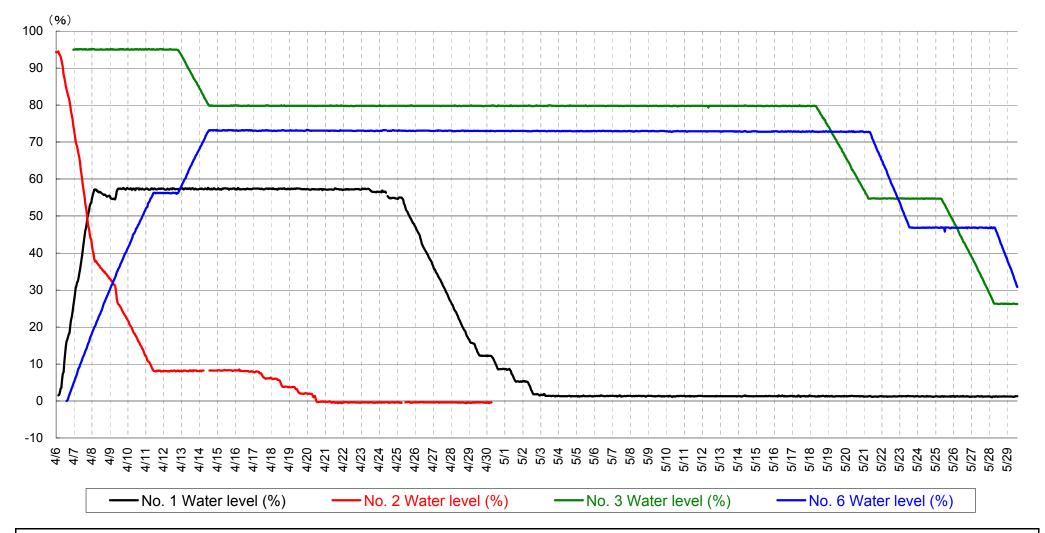

- The data of No. 2 water level was not obtained from 9:00 AM to 3:00 PM on April 14 due to the removal and installation of the water gauge for the installation of temporary pump used for water transfer from the underground reservoir No.2 to the H2 tank.
- Minus indicates the water level is below the lower limit of measurement.
- The water level data was not obtained from 1:00 PM on April 24 due to the computer failure.
- The water level data was not obtained from 10:00 AM to 1:00 PM on April 25 due to the inspection of the water gauge at the underground reservoir No.2.
- The water gauge at the underground reservoir No.2 was removed on April 30