
## Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

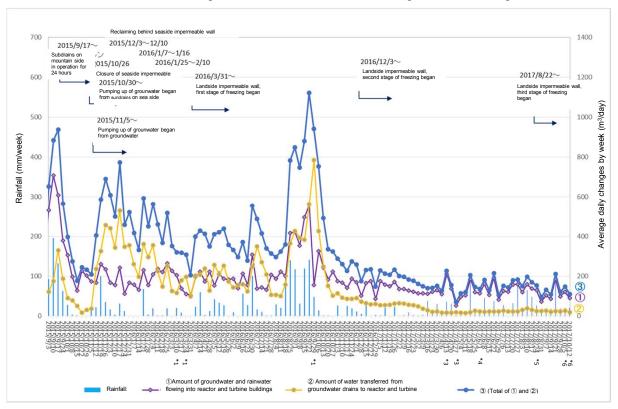

## Amount of water transferred from groundwater drains to reactor and turbine buildings (From October 5, 2017 to October 11, 2017/ 24 hours per day)

									[m3/day]
Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water
	А	В	С	Total* <sup>2</sup> (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total* <sup>2</sup> (β)	transferred to turbine
Oct.5	0	0	0	0	17	0	0	17	17
Oct.6	0	0	0	0	26	0	0	26	26
Oct.7	0	0	0	0	17	0	0	17	17
Oct.8	0	0	0	0	17	0	0	17	17
Oct.9	0	0	0	0	25	0	0	25	25
Oct.10	0	0	0	0	16	0	0	16	16
Oct.11	0	0	0	0	17	0	0	17	17

<sup>\*</sup>①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs: 90m3/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 19m3/day, ③(Total of ① and ②): 109m3/day, Rainfall: 20.0mm/week

<sup>\*1</sup> Water gauges in reactor and turbine buildigns were caliberated.

<sup>\*2</sup> There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

<sup>\*3</sup> The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.

<sup>\*4</sup> The amount of water levels was revision the cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility from June 1, 2017 on.

<sup>\*5 &</sup>quot;①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs" data of August 24, 2017, was revised. (The correct data: 129m3/day, The incorrect data: 133m3/day, )

<sup>\*6 &</sup>quot;①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs" data of October 5 and 12, 2017, was revised.

(The correct data on October 5,: 121m3/day, the incorrect data: 102m3/day. The correct data on October 12,: 90m3/day, the incorrect data: 73m3/day.)