
[m2/day]

## Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

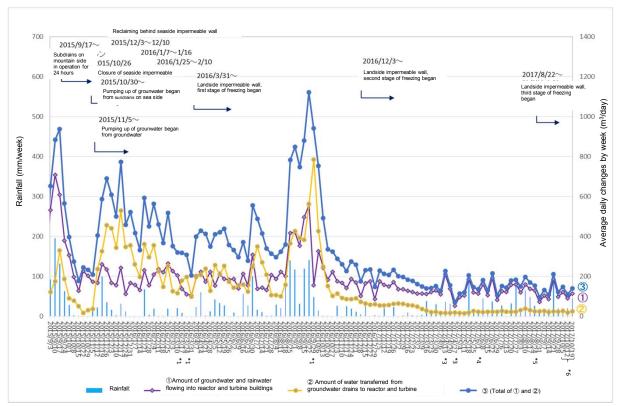

## Amount of water transferred from groundwater drains to reactor and turbine buildings (From October 12, 2017 to October 18, 2017/ 24 hours per day)

									[m3/day]
Date	Temporary storage tanks				(Reference) improved wells and well points				(Reference) Amount of water
	Α	В	С	Total* <sup>2</sup> (α)	Between Units 1-2	Between Units 2-3	Between Units 3-4	Total* <sup>2</sup> (β)	transferred to turbine buildings $[(\alpha)+(\beta)]$
Oct.12	0	0	0	0	34	0	0	34	34
Oct.13	0	0	0	0	25	0	0	25	25
Oct.14	0	0	0	0	17	0	0	17	17
Oct.15	0	0	0	0	24	0	0	24	24
Oct.16	0	0	0	0	16	0	0	16	16
Oct.17	0	0	0	0	26	5	0	32	32
Oct.18	0	0	0	0	25	0	0	25	25

<sup>\*</sup>①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs: 115m3/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 25m3/day, ③(Total of ① and ②): 140m3/day, Rainfall: 43.5mm/week

<sup>\*1</sup> Water gauges in reactor and turbine buildigns were caliberated.

<sup>\*2</sup> There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

<sup>\*3</sup> The amount of water levels conjectures uncertain cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility.

<sup>\*4</sup> The amount of water levels was revision the cross-section for corresponding to the water level, that is needed to calculate for storage capacity of centralized reactive waste treatment facility from June 1, 2017 on.

<sup>\*5 &</sup>quot;①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs" data of August 24, 2017, was revised. (The correct data: 129m3/day, The incorrect data: 133m3/day, )

<sup>\*6 &</sup>quot;①Amount of groundwater and rainwater flowing into reactor and turbine buildinfgs" data of October 5, 12 and 19, 2017, was revised. (The correct data on October 5,: 121m3/day, the incorrect data: 102m3/day. The correct data on October 12,: 90m3/day, the incorrect data: 73m3/day. The correct data on October 19, of the correct data: 115m3/day, the incorrect data: 72m3/day.)