


## Changes in the amount of water transferred from groundwater drains to reactor and turbine buildings and in the amount of groundwater and rainwater flowing into the buildings

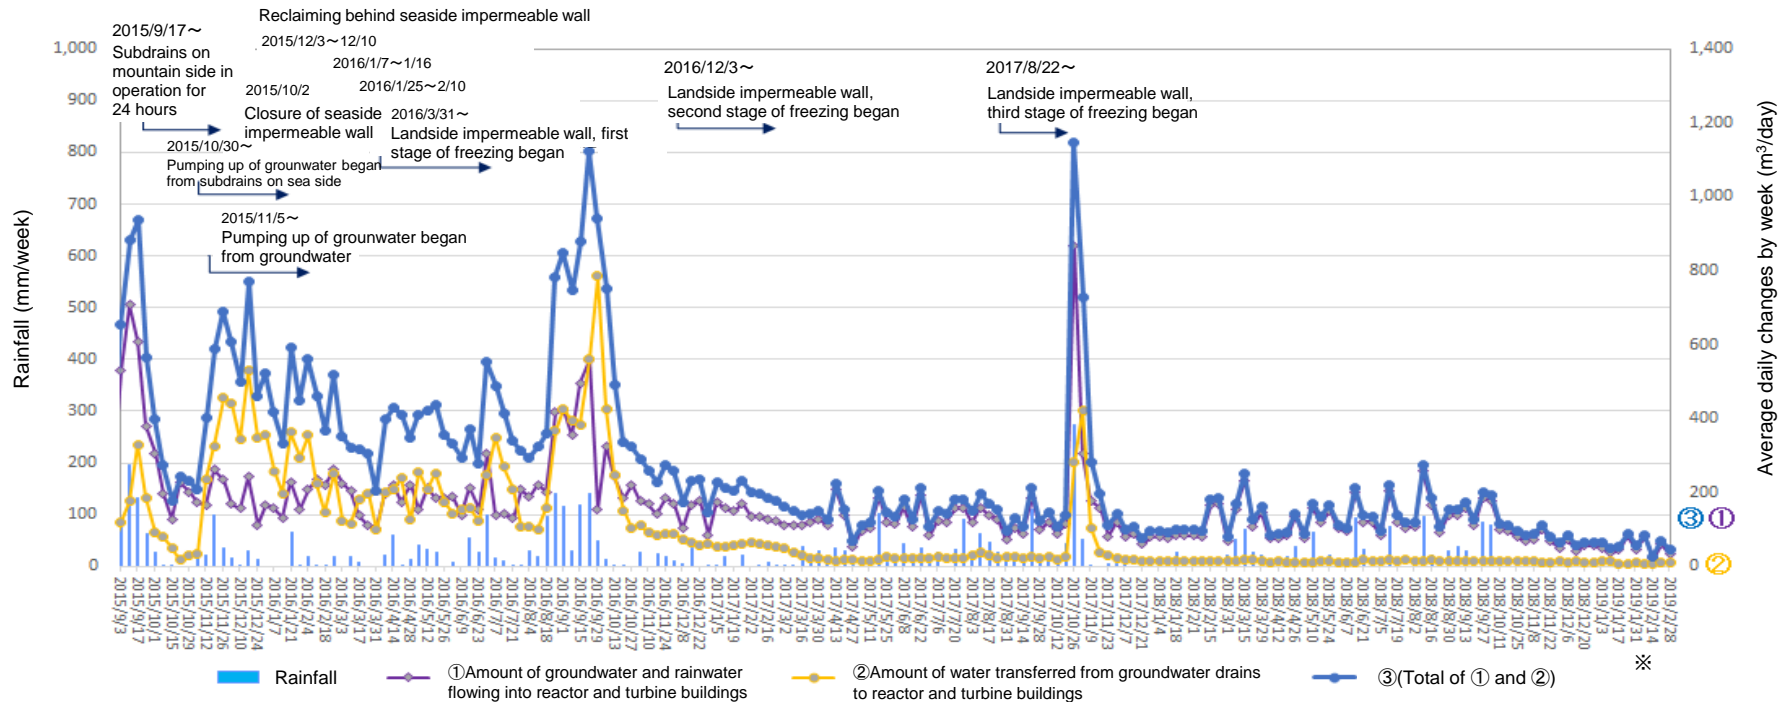

### Amount of water transferred from groundwater drains to reactor and turbine buildings

(From February 21, 2019 to February 27, 2019)

Date	Temporary storage tanks			
	A	B	C	Total (α)
From February 21 to February 27	0	0	0	0

(Reference) improved wells and well points				(Reference) Amount of water transferred to turbine buildings [(α)+(β)]
Between Units 1-2	Between Units 2-3	Between Units 3-4	Total (β)	
10	0	0	10	10

\* ①Amount of groundwater and rainwater flowing into reactor and turbine buildings: 34m<sup>3</sup>/day, ②Amount of water transferred from groundwater drains to reactor and turbine buildings: 10m<sup>3</sup>/day, ③(Total of ① and ②): 44m<sup>3</sup>/day, Rainfall: 0mm/week

\* There are cases where there is a difference between the sum of each number on the table above and the "total" because the "total" is the sum of numbers with one digit after the decimal point.

※ Water gauges in buildings have been replaced (from February 7, 2019).